



# Standard Specification for Thin Veneer Brick Units Made From Clay or Shale<sup>1</sup>

This standard is issued under the fixed designation C 1088; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope\*

1.1 This specification covers thin veneer brick units made from clay, shale, fire clay, sand, or mixtures thereof, and fired to incipient fusion for use in adhered or fastened veneer applications. Three types of thin veneer brick units in each of two grades are covered. In this specification, the term thin veneer brick shall be understood to mean clay masonry unit with a maximum thickness of 1 $\frac{3}{4}$  in. (44.45 mm).

NOTE 1—Brick intended for paving should be specified under Specification C 902.

1.2 The property requirements of this specification apply at the time of purchase. The use of results from testing of brick extracted from masonry structures for determining conformance or nonconformance to the property requirements (Section 5) of this specification is beyond the scope of this specification.

1.3 Brick covered by this specification are manufactured from clay, shale, or similar naturally occurring substances and subjected to a heat treatment at elevated temperatures (firing). The heat treatment must develop sufficient fired bond between the particulate constituents to provide the strength and durability requirements of the specification. (See “firing” and “fired bond” in Terminology C 43.)

1.4 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.5 The text of this specification references notes and footnotes which provide explanatory material. These notes and footnotes (excluding those in tables and figures) shall not be considered as requirements of the standard.

## 2. Referenced Documents

2.1 *ASTM Standards*:<sup>2</sup>

C 43 Terminology of Structural Clay Products

<sup>1</sup> This specification is under the jurisdiction of ASTM Committee C15 on Manufactured Masonry Units and is the direct responsibility of Subcommittee C15.02 on Brick and Structural Clay Tile.

Current edition approved Jan. 1, 2009. Published January 2009. Originally approved in 1988. Last previous edition approved in 2007 as C 1088 – 07a.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard’s Document Summary page on the ASTM website.

C 67 Test Methods for Sampling and Testing Brick and Structural Clay Tile

C 902 Specification for Pedestrian and Light Traffic Paving Brick

E 835/E 835M Guide for Modular Coordination of Clay and Concrete Masonry Units

## 3. Grades

3.1 Two grades of thin veneer brick units are covered for exposure conditions to weather and are defined in Table 1 as Interior and Exterior.

## 4. Types

4.1 Three types of thin veneer brick units are covered as follows:

4.1.1 *Type TBS (Standard)*—Thin veneer brick for general use in masonry.

4.1.2 *Type TBX (Select)*—Thin veneer brick for general use in masonry where a higher degree of precision and lower permissible variation in size than permitted for Type TBS is required.

4.1.3 *Type TBA (Architectural)*—Thin veneer brick for general use in masonry selected to produce characteristic architectural effects resulting from nonuniformity in size and texture of the individual units.

4.2 When the type is not specified, the requirements for Type TBS will govern.

## 5. Physical Properties

5.1 *Durability*—The thin veneer brick shall conform to the physical requirements in Table 1 for the grade specified. When the grade is not specified, the requirements for Grade Exterior shall govern. If the water absorption of each unit is less than 8.0 % after submersion in cold water for 24 h, the requirements for saturation coefficient shall be waived. If exterior or interior grade thin veneer brick are intended for use on interiors only, the requirements for water absorption (5-h boiling) and for saturation coefficient for interior grade in Table 1 shall govern.

5.2 *Freezing and Thawing*—The requirements specified in 5.1 for water absorption (5-h boiling) and saturation coefficient shall be waived provided a sample of 5 typical exterior grade thin veneer brick, meeting all other requirements, complies

\*A Summary of Changes section appears at the end of this standard.

**TABLE 1 Physical Requirements**

Designation	Maximum Water Absorption by 5-h Boiling, %		Maximum Saturation Coefficient <sup>A</sup>	
	Average of 5 units	Individual	Average of 5 units	Individual
Grade Exterior	17.0	20.0	0.78	0.80
Grade Interior	22.0	25.0	0.88	0.90

<sup>A</sup> The saturation coefficient is the ratio of absorption by 24-h submersion in cold water to that after 5-h submersion in boiling water.

with the following requirements when subjected to 50 cycles of the freezing-and-thawing test:

**5.2.1 Grade Exterior: Breakage and Weight Loss Requirement**—No individual unit separates or disintegrates resulting in a weight loss greater than 0.5 % of its original dry weight.

**5.2.2 Grade Exterior: Cracking Requirement**—No individual unit develops a crack that exceeds, in length, the unit’s least face dimension.

**5.3 Low Weathering Index Alternative**—If the thin brick are intended for use exposed to weather where the weathering index is less than 50 (see Fig. 1), and unless otherwise

specified, the requirements given in Table 1 for grade interior shall apply.


**NOTE 2**—The effect of weathering on thin brick is related to the weathering index, which for any locality is the product of the average annual number of freezing cycle days and the average annual winter rainfall in inches (millimetres), defined as follows.

A freezing cycle day is any day during which the air temperature passes either above or below 32°F (0°C). The average number of freezing cycle days in a year may be taken to equal the difference between the mean number of days during which the minimum temperature was 32°F (0°C) or below, and the mean number of days during which the maximum temperature was 32°F (0°C) or below.

Winter rainfall is the sum in inches (millimetres) of the mean monthly corrected precipitation (rainfall) occurring during the period between and including the normal date of the first killing frost in the fall and the normal date of the last killing frost in the spring. The winter rainfall for any period is equal to the total precipitation less one tenth of the total fall of snow, sleet, and hail. Rainfall for a portion of a month is prorated.

**6. Efflorescence**

**6.1** Brick are not required to be tested for efflorescence to comply with this specification unless requested by the specifier or purchaser. When the efflorescence test is requested by the

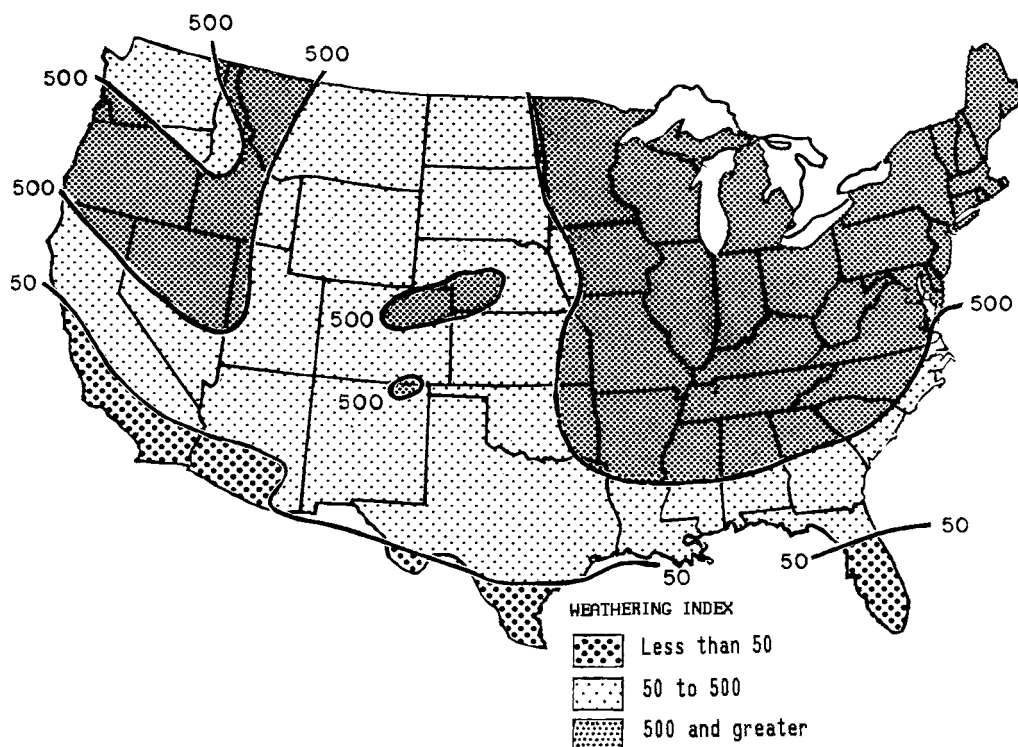

Grade Recommendations for Face Exposures

Exposure	Weathering Index (Note 2)	
	Less than 50	50 and greater
In vertical surfaces:		
In contact with earth	MW	SW
Not in contact with earth	MW	SW
In other than vertical surfaces:		
In contact with earth	SW	SW
Not in contact with earth	MW	SW

**FIG. 1 Weathering Indices in the United States**

specifier or purchaser, the brick shall be sampled at the place of manufacture, and tested in accordance with Test Methods **C 67**, and a rating for efflorescence shall be “not effloresced.” If the rating for efflorescence is “effloresced,” the brick represented by the testing do not meet the efflorescence requirements of this specification.

## 7. Material, Finish, and Manufacturer Limitation

7.1 Units shall not show surface defects and deficiencies, nor effects of surface treatments including coating in the manufacturing process, that interfere with installation of the brick or significantly impair the performance of the construction.

7.2 Colors and textures produced by application of inorganic coatings to the faces of the thin veneer brick are permitted if approved by the purchaser, provided that evidence is furnished of the durability of the coatings.

### 7.3 Face or Faces:

7.3.1 The face or faces that will be exposed in place shall be free of chips that exceed the limits given in **Table 2**. The aggregate length of chips shall not exceed 10 % of the perimeter of the face or faces of the thin veneer brick.

7.3.2 The face or faces shall not contain cracks or other imperfections that detract from the appearance of the designated sample when viewed from a distance of 15 ft (4.6 m) for Type TBX and a distance of 20 ft (6.1 m) for Types TBS and TBA.

7.4 The number of thin veneer brick in a delivery that are broken or otherwise fail to meet the requirements for chippage and tolerances shall not exceed 5 %.

7.5 After thin veneer brick are installed, the manufacturer or the manufacturer’s agent shall not be held responsible for compliance of thin veneer brick with the requirements of this specification for chippage and tolerances.

## 8. Color and Texture

8.1 If brick having a particular color, color range, or texture are desired, these features shall be specified separately by the purchaser. The texture of the finished surfaces that will be

exposed when in place shall conform to an approved sample consisting of not less than four typical stretcher thin veneer brick, each representing the desired texture. The color range shall be indicated by the approved sample.

## 9. Size and Tolerances

9.1 *Size*—The face size of thin veneer brick shall be as specified by the purchaser. In a representative sample of ten units selected to include the extreme range of color and dimensions of thin veneer brick to be supplied for each size and color combination in the purchase order, no thin brick shall depart from the specified size by more than the individual tolerance for the type specified as prescribed in **Table 3**. Tolerances on dimensions for Type TBA shall be as specified by the purchaser.

NOTE 3—For a list of modular sizes see Guide **E 835/E 835M**. Sizes listed in this standard are not produced in all parts of the United States. Brick names denoting sizes may be regional and therefore may not be included in all reference books. Purchasers should ascertain the size of brick available in their locality and should specify accordingly, stating the desired dimensions (width by height by length).

9.2 *Warpage*—Tolerances for distortion or warpage of face or edges of individual units from a plane surface shall not exceed the maximum for the type specified as prescribed in **Table 4**. Tolerances on distortion for Type TBA shall be as specified by the purchaser.

## 10. Sampling and Testing

10.1 The brick shall be sampled and tested in accordance with applicable sections in Test Methods **C 67**.

10.2 The manufacturer or the seller shall furnish specimens for tests. The place or places of selection shall be designated when the purchase order is placed.

NOTE 4—Unless otherwise specified in the purchase order, the cost of tests is typically borne as follows: if the results of the test show that brick do not conform to the requirements of this specification, the cost is typically borne by the seller. If the results of the tests show that the brick do conform to the requirements of this specification, the cost is typically borne by the purchaser.

**TABLE 2 Maximum Permissible Extent of Chippage from the Edges and Corners of Finished Face or Faces onto the Surface**

Type	Percentage Allowed <sup>A</sup>	Chippage in in. (mm) in from		Percentage Allowed <sup>A</sup>	Chippage in in. (mm) in from	
		Edge	Corner		Edge	Corner
TBX	5 % or less	1/8 to 1/4 (3.2 to 6.4)	1/4 to 3/8 (6.4 to 9.5)	95 to 100 %	0 to 1/8 (0 to 3.2)	0 to 1/4 (0 to 6.4)
TBS (formed) <sup>B</sup>	10 % or less	1/4 to 5/16 (6.4 to 7.9)	3/8 to 1/2 (9.5 to 12.7)	90 to 100 %	0 to 1/4 (0 to 6.4)	0 to 3/8 (0 to 9.5)
TBS (altered) <sup>C</sup>	15 % or less	5/16 to 7/16 (7.9 to 11.1)	1/2 to 3/4 (12.7 to 19.1)	85 to 100 %	0 to 5/16 (0 to 7.9)	0 to 1/2 (0 to 12.7)
TBA		as specified by the purchaser			as specified by the purchaser	

<sup>A</sup> Percentage of exposed brick allowed in the wall with chips measured the listed dimensions in from an edge or corner.

<sup>B</sup> Formed units are extruded brick with an unbroken natural die finish face.

<sup>C</sup> Altered units are extruded brick with the face sanded, combed, scratched, scarified, or broken by mechanical means such as wire-cutting or wire brushing, or are molded brick.

**TABLE 3 Tolerances on Dimensions<sup>A</sup>**

Specified Dimension, in. (mm)	Maximum Permissible Variation from Specified Dimension, ±in. (mm)	
	Type TBX	Type TBS
3 (76) and under	1/16 (1.6)	3/32 (2.4)
Over 3 to 4 (76 to 102) incl	3/32 (2.4)	1/8 (3.2)
Over 4 to 6 (102 to 152) incl	1/8 (3.2)	3/16 (4.7)
Over 6 to 8 (152 to 203) incl	5/32 (4.0)	1/4 (6.4)
Over 8 to 12 (203 to 305) incl	7/32 (5.6)	5/16 (7.9)
Over 12 to 16 (305 to 406) incl	9/32 (7.1)	3/8 (9.5)

<sup>A</sup> Tolerances for Type TBA shall be listed in purchase specification.

**TABLE 4 Tolerances on Distortion<sup>A</sup>**

Maximum Face Dimension, in. (mm)	Maximum Permissible Distortion, in. (mm)	
	Type TBX	Type TBS
8 (203) and under	1/16 (1.6)	3/32 (2.4)
Over 8 to 12 (203 to 305) incl	3/32 (2.4)	1/8 (3.2)
Over 12 to 16 (305 to 406) incl	1/8 (3.2)	5/32 (4.0)

<sup>A</sup> Tolerances for Type TBA shall be listed in purchase specification.

## SUMMARY OF CHANGES

Committee C15 has identified the location of selected changes to this standard since the last issue (C 1088 – 07a) that may impact the use of this standard. (Approved Jan. 1, 2009.)

(I) The breakage endpoint for Grade Exterior in 5.2 was set at a quantifiable percentage of dry weight.

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).*