



Standard Test Method for Determining the Tensile Properties of an Insulating Glass Edge Seal for Structural Glazing Applications¹

This standard is issued under the fixed designation C 1265; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

^{e1} NOTE—Editorial changes were made throughout in July 2005.

1. Scope

1.1 This test method covers a laboratory procedure for quantitatively measuring the tensile strength, stiffness, and adhesion properties of insulating glass edge seals that are used in structural sealant glazing applications. Edge seals for these applications use a structural sealant to bond both glass lites and the edge spacer into a monolithic sealed insulating glass unit. In typical applications, the structural sealant acts to hold the outside lite in place under wind and gravity load and to maintain the edge spacer in its proper position. Hereafter, the term “insulating glass” will be abbreviated as “IG.”

1.2 The characterization of the IG secondary sealant properties, as defined by this test method, are strongly dependent on glass and edge spacer cleaning procedures, IG spacer profile, location of spacer, and primary IG sealant application. Users of this test method must recognize that the IG edge seal assembly influences the secondary sealant properties.

1.3 The values determined by this test method will be characteristic of the particular edge seal assembly that is tested.

NOTE 1—Presently, only elastomeric, chemically curing silicone sealants specifically formulated for use as the secondary seal of IG units are recognized as having the necessary durability for use in structural sealant glazing applications.

1.4 The values stated in SI (metric) units are to be regarded as the standard. The inch-pound values given in parentheses are approximate equivalents, provided for information purposes.

2. Referenced Documents

2.1 ASTM Standards:²

C 717 Terminology of Building Seals and Sealants

¹ This test method is under the jurisdiction of ASTM Committee of C24 on Building Seals and Sealants and is the direct responsibility of Subcommittee C24.30 on Adhesion.

Current edition approved July 1, 2005. Published August 2005. Originally approved in 1994. Last previous edition approved in 1999 as C 1265-94(1999).

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

3. Terminology

3.1 *Definitions*—Refer to Terminology **C 717** for definitions of the following terms used in this test method: *adhesive failure, cohesive failure, elastomeric, glazing, lite, primer, seal, sealant, silicone sealant, structural sealant, substrate.*

4. Summary of Test Method

4.1 Five specimens are fabricated to duplicate the edge seal design of an IG unit for structural glazing applications. After the secondary structural sealant is cured the specimens are tested to failure in tension. Testing is conducted at $23 \pm 2^\circ\text{C}$ ($74 \pm 3.6^\circ\text{F}$) at a rate of 5 ± 0.5 mm (0.2 ± 0.02 in.) per minute. Strength, load-displacement response, failure mode, and primary IG edge seal behavior are recorded.

5. Significance and Use

5.1 Frequently IG units are adhered with a structural sealant to a metal framing system. In such applications, only the inward lite of glass is usually adhered to the frame. As a result, a significant portion of any outward-acting or negative wind load must be carried in tension by the joint seal between the two lites of the IG unit. This test will not provide information on the integrity of the IG unit primary seal; however, it may provide data on load sharing between the primary IG vapor seal and the secondary structural sealant.

5.2 Although this test method prescribes one environmental condition, other environmental conditions and exposure cycles can be employed for specific project evaluation. Such deviations should be described when reporting the data.

6. Apparatus and Accessory Materials

6.1 *Tensile Testing Machine*, capable of producing a tensile load on the specimen at a rate of 5.0 ± 0.5 mm (0.20 ± 0.02 in.) per minute. The machine shall be capable of measuring the load to ± 4 N (± 1 lb). See **Fig. 1**.

6.1.1 *Fixed Member*—A fixed or essentially stationary member carrying a grip.

6.1.2 *Movable Member*—A movable member carrying a second grip.

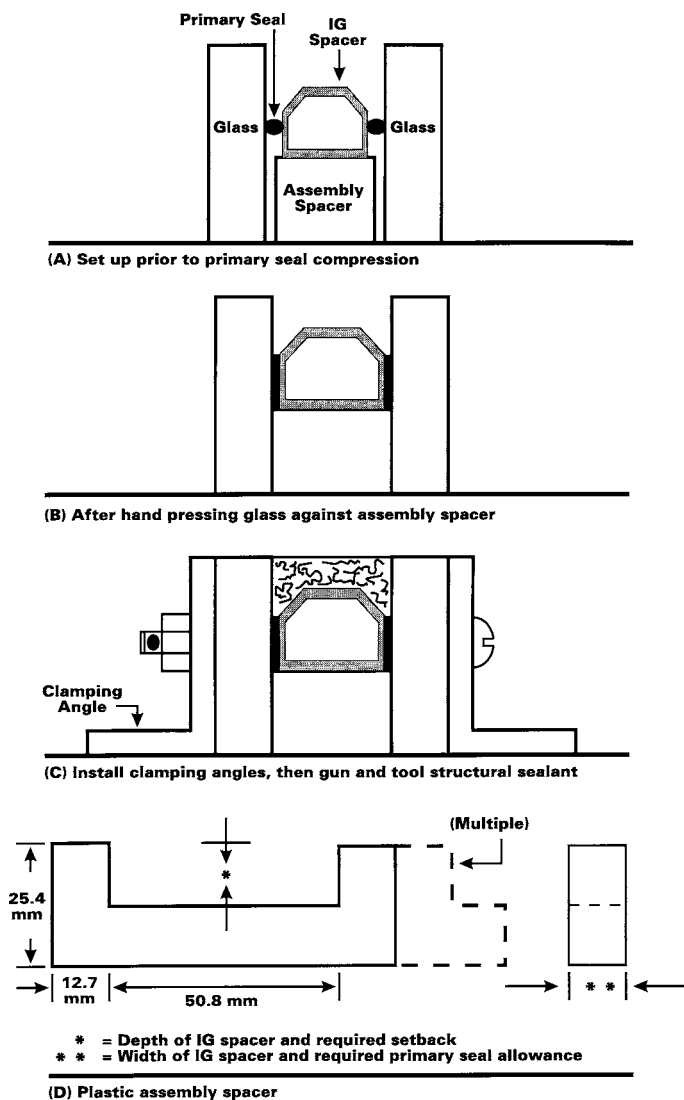


FIG. 1 Suggested Assembly Method

6.1.3 *Grips*—The grips should be suitable to firmly grasp the test fixture that holds the test specimen and should be designed to minimize eccentric specimen loading. Specimen loading should be perpendicular to both glass substrates. A swivel or universal joint near one or both ends of the test specimen may be helpful for alignment purposes.

6.1.4 *Grip Fixture*—A fixture capable of being held by the grips and furnishing a tensile force to the joint specimen.

6.2 *Spatulas*, for use in applying sealant.

6.3 *Caulking Gun*, for extruding sealant from cartridges when applicable.

6.4 *Glass Substrates*, of the same type(s) as used in the joint design being evaluated.

NOTE 2—This test method is based on glass substrates of 6.3 by 25 by 76 mm (0.25 by 1.0 by 3.0 in.) in size. Other thicknesses may be tested; however, consideration should be given to preventing breakage or excessive bending of the glass during testing.

NOTE 3—The sample tested should reflect the actual IG unit edge construction; that is, glass with sensitive coatings should be tested as they are used. If a coating is edge-deleted in practice, it should be edge-deleted for the test.

6.5 *Edge Spacer*—The spacer should be identical in material, cross section, and surface finish to the spacer to be used in the IG edge seal design being evaluated.

6.6 *Primary Sealant*—This sealant or sealant tape, that is non-structural, provides a vapor seal for the IG unit. Its presence and configuration affects the geometry and behavior of many structural IG edge seal designs; therefore, it should be included as part of the specimen.

6.7 *Assembly Spacer(s)*—Spacer(s) or end blocks, or both, made from TFE-fluorocarbon or other suitable non-bonding material are used to maintain the proper specimen dimensions during specimen assembly. Because details of specimens tested by this test method will vary, it is not possible to define a single spacer or end block shape.

6.8 *Glass Substrate Cleaning Materials:*

6.8.1 *Primary*—Materials common to industry practice for the IG unit being evaluated.

6.8.2 *Alternate*—Clean, dry, lint-free cloths. A 0.1 % solution of clear hand dishwashing detergent.³ The solution should be made up in distilled or deionized water.

6.9 *Edge Spacer Cleaning Materials:*

6.9.1 *Primary*—Materials common to industry practice of the IG unit being evaluated.

6.9.2 *Alternate*—Clean, dry, lint-free cloths. Isopropyl alcohol (99 %).

7. Test Specimen Assembly

7.1 *Assembly:*

7.1.1 *Glass Cleaning Procedure:*

7.1.1.1 Prior to assembly, clean the glass using the methods recommended by the manufacturer of the IG unit being evaluated.

7.1.1.2 When no manufacturer's cleaning guidelines are available, wipe substrates with a clean, dry, lint-free cloth, then thoroughly clean with a second clean, lint-free cloth and 0.1 % solution of a clear hand dishwashing detergent,³ as described in 6.8. Rinse the surfaces (without touching them) in distilled or deionized water and allow to air dry.

7.1.2 *Edge Spacer Cleaning Procedure:*


7.1.2.1 Prior to assembly, clean the edge spacer using the methods used by the manufacturer of the IG unit being evaluated.

7.1.2.2 When no manufacturer's cleaning guidelines are available, wipe substrates with a clean, dry, lint-free cloth, then thoroughly clean with a second clean, lint-free cloth and diisopropyl alcohol (99 %) and allow to air dry.

7.1.3 Construct the test specimen assemblies by forming a sealant cavity 50 mm (2.0 in.) long, with a cavity width and depth as dictated by the joint design being evaluated. (See Fig. 2). Care should be taken to ensure that assembly of the substrate panels, IG joint spacer, and primary IG joint seal are representative of the actual joint design.

7.2 *Sample Preparation:*

³ Dawn, made by Proctor and Gamble Co., P.O. Box 599, Cincinnati, OH 54201, and Palmolive Green, made by Colgate Palmolive Co., 300-T Park Avenue, New York, NY 10022, have been found suitable for this purpose.

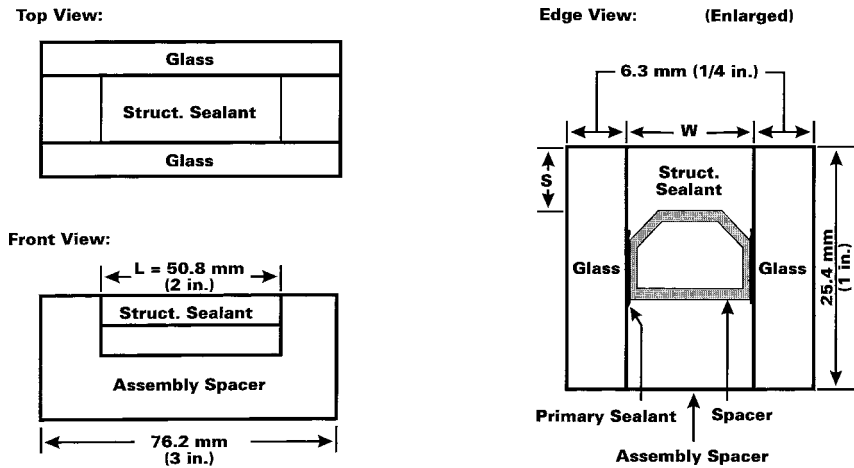

W = distance between the glass
S = distance from bottom of spacer to glass edge

FIG. 2 Test Specimen

7.2.1 Prepare a minimum of five specimens for each sealant, substrate, and geometry combination being tested, as shown in Fig. 2.

NOTE 4—Five test specimen assemblies should be prepared for each additional environmental condition being evaluated.

7.2.2 Each specimen in each set should be individually identified.

7.2.3 Fig. 1 shows a suggested approach to assembly of the two pieces of glass, the IG edge spacer, and the two primary IG edge seals prior to application of the secondary structural sealant. Special care must be given to accurate placement of all assembly components. Also, it is important that the final configuration (thickness, width, and position) of the primary IG edge seal match that seen in the actual joint design being evaluated. See Appendix XI for a discussion of assembly procedures that have been found suitable.

7.2.4 Fill each assembly with the secondary structural sealant that is to be tested. Immediately tool the sealant surface to ensure complete filling of the cavity and wetting of the substrate surfaces. Take special care to strike off the sealant flush with the glass edges.

7.3 Conditioning:

7.3.1 The structural sealant manufacturer’s recommended curing conditions and time should be followed. In the absence of specific manufacturer’s recommendations, cure the specimens for 21 days (one part sealants) or seven days (two part sealants) at 23 ± 2°C (73 ± 4°F) and 50 ± 6 % relative humidity. List any deviations in curing conditions in the report.

7.3.2 Remove all assembly spacer sections, but not the IG edge spacer. If assembly spacers are removed prior to the cure time given in 7.3.1, note this in the report.

8. Procedure

8.1 Testing

8.1.1 Measure and record to the nearest 0.5 mm (0.02 in.) the actual minimum length (dimension L), minimum bond width (dimension W) and minimum IG spacer setback (dimension S), as shown in Fig. 2.

8.1.2 All specimens are pulled on the tensile test machine at 23 ± 2°C (73 ± 4°F) and 50 ± 6 % relative humidity. Test speed shall be 5 ± 0.5 mm (0.2 ± 0.02 in.) per minute. The orientation of the specimen in the test grips is shown in Fig. 3.

8.1.3 Record tensile load, in Newtons (lbs) versus elongation percent by a continuous plot or at 0.5 mm (0.02 in.) intervals to an elongation of 10 %. Also record the load at elongations of 25, 50, and 100 %. Record the initial load peak at failure of the primary IG seal (see Fig. 3). Record the elongation when maximum load is first reached and the highest value of elongation achieved at maximum load, if some yielding of the maximum load is evident.

8.1.4 Record the nature of the failure, whether cohesive or adhesive, or what percentage is cohesive.

8.2 Observations:

8.2.1 If possible, observe and record the elongation causing failure of the IG primary seal. This may be taken as the elongation corresponding to the initial load peak due to the primary IG seal failure if such a peak is evident.

8.2.2 Observe the specimens and record any obvious air bubbles trapped in the sealant during the preparation of the test specimens.

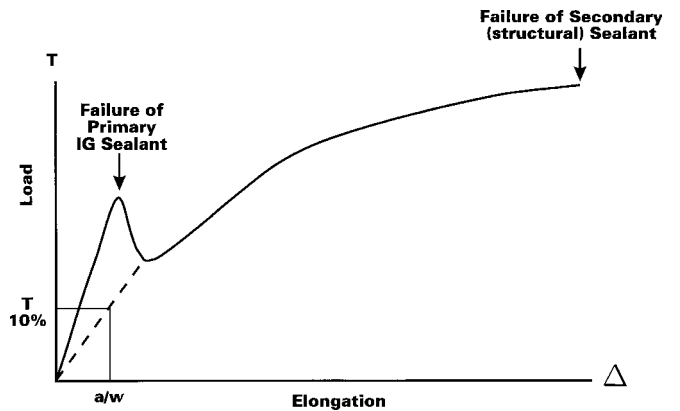


FIG. 3 Typical Load Versus Elongation Plot

9. Calculation

9.1 Calculate the force per unit length or joint (R), in N/mm (lbs/in.):

$$Rs = T/Ls = setback \tag{1}$$

where:

T = the applied tensile force and L is the dimension L in Fig. 2.

9.2 Calculate the nominal elastic stiffness of the joint per unit length in N/mm/mm (lbs/in./in.) at the 10 % elongation level by the approximation (see Fig. 3):

$$^K 10 \% = ^T 10 \% / (0.1 * L * W) \tag{2}$$

where:

^T10 % = the measured or estimated force at 10 % elongation,

L = length of bond, and

W = the width between inside faces of the substrate panels.

10. Report

10.1 Report the following information:

10.1.1 The test data and observations are to be reported on the form shown in Fig. 4 or similar.

10.1.2 Provide a scale sketch of the specimen cross section, showing details of IG edge spacer and primary seal placement and the setback of the spacer.

10.1.3 Report the substrate cleaning procedure. Also, report if the spacers were removed prior to the end of the cure period, if the curing conditions deviated from those listed, and any other deviation from the method.

10.1.4 Report tensile force per unit length in N/mm (lbs/in.) at 10, 25, 50, 100 % and at maximum elongation, as calculated in 9.1.

10.1.5 Report percent elongation at maximum tensile load.

10.1.6 Report nominal elastic stiffness at 10 % elongation, as calculated in 9.2.

10.1.7 Report mode of failure in percent cohesive failure.

10.1.8 If evident, report the load and elongation at the initial load peak due to the primary IG sealant failure.

10.1.9 Report any observations from 8.2.

11. Precision and Bias

11.1 *Test Method for Edge Seal Strength 1/4 in. (6 mm) Setback, 10 % Elongation at Test Load:*

11.1.1 *I(r)*—The repeatability (within a given laboratory) interval for 1 material tested by five laboratories is 17.630 psi. In future use of this test method, the difference between two test results obtained in the same laboratory on the same material will be expected to exceed 17.630 psi only about 5 % of the time.

11.1.2 *I(R)*—The reproducibility (between given laboratories) interval for one material tested by five laboratories is 40.562 psi. In future use of this test method, the difference between two test results obtained in a different laboratory on the same material will be expected to exceed 40.562 psi only about 5 % of the time.

11.2 *Test Method for Edge Seal Strength 1/4 in. (6 mm) Setback, 25 % Elongation at Test Load:*

11.2.1 *I(r)*—The repeatability (within a given laboratory) interval for one material tested by five laboratories is 23.308 psi. In future use of this test method, the difference between two test results obtained in the same laboratory on the same material will be expected to exceed 23.308 psi only about 5 % of the time.

11.2.2 *I(R)*—The reproducibility (between given laboratories) interval for one material tested by five laboratories is 72.665 psi. In future use of this test method, the difference between two test results obtained in a different laboratory on the same material will be expected to exceed 72.665 psi only about 5 % of the time.

11.3 *Test Method for Edge Seal Strength 1/4 in. (6 mm) Setback, 50 % Elongation at Test Load:*

11.3.1 *I(r)*—The repeatability (within a given laboratory) interval for one material tested by five laboratories is 27.916 psi. In future use of this test method, the difference between two test results obtained in the same laboratory on the same material will be expected to exceed 27.916 psi only about 5 % of the time.

11.3.2 *I(R)*—The reproducibility (between given laboratories) interval for one material tested by five laboratories is 103.242 psi. In future use of this test method, the difference between two test results obtained in a different laboratory on the same material will be expected to exceed 103.242 psi only about 5 % of the time.

11.4 *Test Method for Edge Seal Strength 1/4 in. (6 mm) Setback, 100 % Elongation at Test Load:*

11.4.1 *I(r)*—The repeatability (within a given laboratory) interval for one material tested by five laboratories is 40.034 psi. In future use of this test method, the difference between

Specimen Name:	Date Made:
Structural Sealant:	Date Tested:
Primary Sealant:	
Glass Type:	Curing Conditions:
IG Spacer—Type:	Test Conditions:
Width, W:	
Setback, S:	

Specimen	1	2	3	4	5
Actual Width, W					
Actual Setback, S					
Actual Length, L					
Test Load at Various Elongations:	10%	25%	50%	100%	
Max. Test Load:					
Elongation at Max. Load:					
Primary Seal Load: Failure, Elongation:					
Sketch of Specimen Cross-Section: (Include a detailed sketch, tracing, or ink pad impression of the spacer cross-section.)	Substrate Cleaning Procedure:				
	Observations:				

FIG. 4 Suggested Format for Test Data

two test results obtained in the same laboratory on the same material will be expected to exceed 40.034 psi only about 5 % of the time.

11.4.2 *I(R)*—The reproducibility (between given laboratories) interval for one material tested by five laboratories is 126.137 psi. In future use of this test method, the difference between two test results obtained in a different laboratory on the same material will be expected to exceed 126.137 psi only about 5 % of the time.

11.5 *Test Method for Edge Seal Strength 1/2 in. (12.5 mm) Setback, 10 % Elongation at Test Load:*

11.5.1 *I(r)*—The repeatability (within a given laboratory) interval for one material tested by five laboratories is 9.714 psi. In future use of this test method, the difference between two test results obtained in the same laboratory on the same material will be expected to exceed 9.714 psi only about 5 % of the time.

11.5.2 *I(R)*—The reproducibility (between given laboratories) interval for one material tested by five laboratories is 40.303 psi. In future use of this test method, the difference between two test results obtained in a different laboratory on the same material will be expected to exceed 40.303 psi only about 5 % of the time.

11.6 *Test Method for Edge Seal Strength 1/2 in. (12.5 mm) Setback, 25 % Elongation at Test Load:*

11.6.1 *I(r)*—The repeatability (within a given laboratory) interval for one material tested by five laboratories is 11.481 psi. In future use of this test method, the difference between two test results obtained in the same laboratory on the same material will be expected to exceed 11.481 psi only about 5 % of the time.

11.6.2 *I(R)*—The reproducibility (between given laboratories) interval for one material tested by five laboratories is

57.896 psi. In future use of this test method, the difference between two test results obtained in a different laboratory on the same material will be expected to exceed 57.896 psi only about 5 % of the time.

11.7 *Test Method for Edge Seal Strength 1/2 in. (12.5 mm) Setback, 50 % Elongation at Test Load:*

11.7.1 *I(r)*—The repeatability (within a given laboratory) interval for one material tested by five laboratories is 12.877 psi. In future use of this test method, the difference between two test results obtained in the same laboratory on the same material will be expected to exceed 12.877 psi only about 5 % of the time.

11.7.2 *I(R)*—The reproducibility (between given laboratories) interval for one material tested by five laboratories is 67.293 psi. In future use of this test method, the difference between two test results obtained in a different laboratory on the same material will be expected to exceed 67.293 psi only about 5 % of the time.

11.8 *Test Method for Edge Seal Strength 1/2 in. (12.5 mm) Setback, 100 % Elongation at Test Load:*

11.8.1 *I(r)*—The repeatability (within a given laboratory) interval for one material tested by five laboratories is 10.737 psi. In future use of this test method, the difference between two test results obtained in the same laboratory on the same material will be expected to exceed 10.737 psi only about 5 % of the time.

11.8.2 *I(R)*—The reproducibility (between given laboratories) interval for one material tested by five laboratories is 82.270 psi. In future use of this test method, the difference between two test results obtained in a different laboratory on the same material will be expected to exceed 82.270 psi only about 5 % of the time.

APPENDIX

(Nonmandatory Information)

X1. SUGGESTED ASSEMBLY PROCEDURES

X1.1 Check the fit of the edge spacers in the assembled spacers prior to cleaning the edge spacer. Following proper cleaning of the glass and edge spacers, place the primary sealant beads on each side of the edge spacer. Take care to provide the proper amount in the correct position for the particular edge spacer being used. Avoid contamination of the edge spacer surface that will be in contact with the secondary, structural sealant. Place the edge spacer in the assembly spacer cavity. Press it into the bottom of the cavity with a clean spatula. Set the upright assembly spacer on a flat level surface. Place the two pieces of glass on edge adjacent to opposite sides of the edge spacer. Take care not to contaminate the glass

surfaces that will be in contact with the structural sealant. Align the glass pieces to center the edge spacer. Hand press the glass pieces into the primary sealant beads, keeping the bottom edges of the glass in contact with the flat surface. The primary sealant should hold the glass in position for final clamping. Place the clamping angles on each side of the assembly and install the clamping screws and nuts. Carefully tighten the clamping screws to compress the glass against the assembly spacer. Check for proper compression of the primary sealant beads. The specimen is now ready for application of the secondary sealant.

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).