



Standard Practice for Capping Concrete Masonry Units, Related Units and Masonry Prisms for Compression Testing¹

This standard is issued under the fixed designation C 1552; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope*

1.1 This practice covers apparatus, materials, and procedures for capping concrete masonry units, related units, including coupons or other specimens obtained from such units, and masonry prisms for compression testing.

NOTE 1—The testing laboratory performing these test methods should be evaluated in accordance with Practice C 1093.

1.2 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:²

C 140 Test Methods for Sampling and Testing Concrete Masonry Units and Related Units

C 617 Practice for Capping Cylindrical Concrete Specimens

C 1093 Practice for Accreditation of Testing Agencies for Masonry

C 1209 Terminology of Concrete Masonry Units and Related Units

C 1232 Terminology of Masonry

C 1314 Test Method for Compressive Strength of Masonry Prisms

3. Terminology

3.1 Terminology defined in Terminology C 1209 and Terminology C 1232 shall apply for this practice.

¹ This practice is under the jurisdiction of ASTM Committee C15 on Manufactured Masonry Units and is the direct responsibility of Subcommittee C15.04 on Research.

Current edition approved Nov. 1, 2008. Published November 2008. Originally approved in 2002. Last previous edition approved in 2008 as C 1552 – 08.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

4. Significance and Use

4.1 This practice describes procedures for providing plane surfaces on the two bearing surfaces of units and prisms. The purpose of this standard is to provide consistent and standardized procedures for capping units and prisms for compression testing. The procedures are based on those contained (or previously contained) in Test Methods C 140, Practice C 617, and Test Method C 1314.

NOTE 2—Specimens capped using this practice will vary significantly in size and weight. Appropriate care and handling may differ based on specimen size and weight. Provide care and handling as needed to provide for proper capping based on the physical characteristics of the specimen being capped.

5. Apparatus

5.1 *Capping Plate*—If used, the capping plate shall be made of steel having a thickness of not less than 1 in. (25.4 mm), or a polished plate of granite or diabase at least 3 in. (76 mm) thick. The capping surface shall be plane within 0.003 in. in 16 in. (0.075 mm in 400 mm) and shall be free of gouges, grooves, and indentations greater than 0.010 in. (0.25 mm) deep or greater than 0.05 in.² (32 mm²) in surface area. At the time of capping, the capping surface shall be level within 1/16 in. (1.6 mm) over the length of the plate.

5.1.1 *Capping Wear Plate*—If used, the capping wear plate shall be placed directly on top of the capping plate and shall meet the requirements of 5.2. At the time of capping, the wear plate surface shall be level within 1/16 in. (1.6 mm) over the length of the plate. Do not use a capping wear plate with sulfur capping materials.

NOTE 3—A capping wear plate has been found to reduce the potential of damage to the capping plate. The capping wear plate is typically more resistant to scratches and can be replaced at less cost than that required to resurface the capping plate. See Fig. 1 for a schematic of capping setup when using gypsum cement materials.

5.2 *Casting Plate*—If used, the casting plate shall be of transparent glass with a thickness of not less than 1/2 in. (13 mm). The casting plate shall be plane within 0.003 in. in 16 in. (0.075 mm in 400 mm).

6. Materials

6.1 Capping Materials:

6.1.1 High Strength Gypsum Cement Capping Materials:

*A Summary of Changes section appears at the end of this standard.

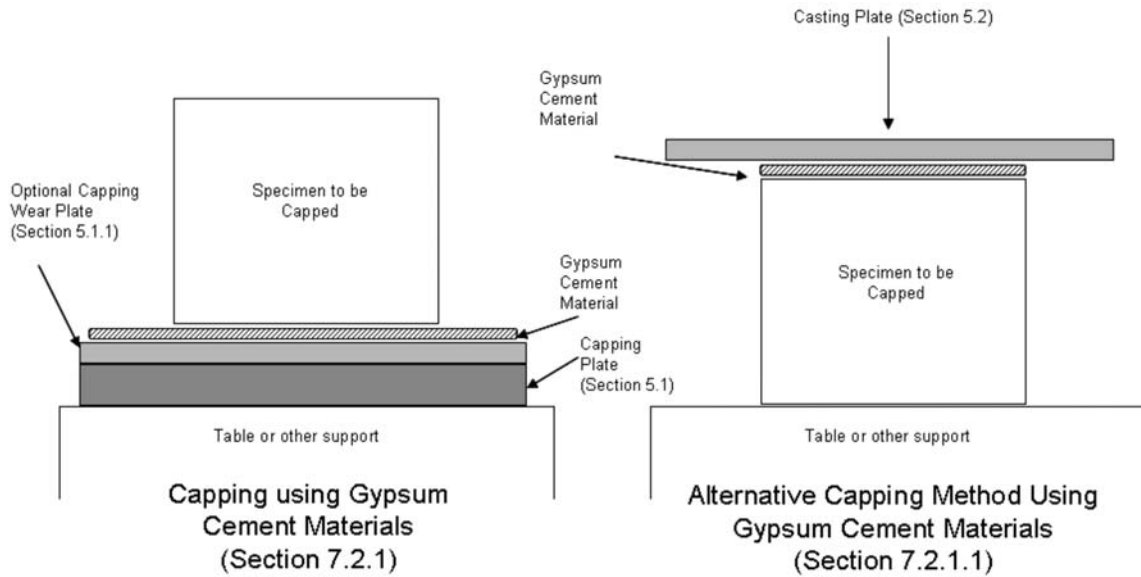


FIG. 1 Gypsum Capping Schematic

6.1.1.1 In addition to the compressive strength testing required in 6.2, qualification tests shall be made to determine the effects of water-cement ratio and age on compressive strength. Procedures used for preparing the high strength gypsum cement capping materials shall ensure that water-cement ratios used for each batch provide the required strength.

NOTE 4—The water-gypsum cement ratio should typically be between 0.26 and 0.30. Use of low water-gypsum cement ratios and vigorous mixing will usually permit development of 3500 psi (24.1 MPa) at ages of one or two hours. Higher water-gypsum cement ratios extend working time, but reduce strength.

6.1.1.2 Do not add fillers or extenders to the high strength gypsum cement.

NOTE 5—Retarders extend working time for capping materials but their effects on required water-cement ratio should be determined prior to use.

NOTE 6—The following two gypsum cements have successfully been used for this purpose: Hydrostone (trademarked) and Hydrocal (trademarked) white gypsum cement. Both are available from U.S. Gypsum Company.

6.1.2 Sulfur Capping Materials:

6.1.2.1 Proprietary or laboratory prepared sulfur mixtures shall contain 40 to 60 % sulfur by weight, the remainder being ground fire clay or other suitable inert material passing a No. 100 (150- μ m) sieve with or without a plasticizer.

6.1.3 Use only capping materials identified in 6.1.1 and 6.1.2. Do not use other capping materials.

NOTE 7—Examples of materials that have been found to be unsuitable for capping purposes include, but are not limited to: low-strength molding plaster, plaster of paris, mixtures of plaster of paris and portland cement, and other cement-based materials.

6.2 Compressive Strength of Capping Materials—The compressive strength of the capping material shall be at least 3500 psi (24.1 MPa) at an age of 2 h. The cube molds and methods of preparing and testing the cubes shall be in accordance with Practice C 617. The capping material shall be placed in the cube at capping consistency. Store the filled molds in labora-

tory air. Remove cubes of sulfur material after solidification is complete and remove cubes of gypsum cement material from the molds not more than 15 min prior to testing. Test cubes at an age of 2 h \pm 10 min after completing the filling of the molds.

6.2.1 The strength of the capping material shall be determined on receipt of a new lot and at intervals not exceeding three months. If a given test of the capping material fails to conform to the strength requirements, the package from which the material was sampled shall not be used unless two additional subsequent samples are taken from the same package and both of these subsequent samples conform to the strength requirements. If the strength tests from an individual package are inadequate, randomly obtain and test three additional samples from the lot. These additional samples shall be taken from separate packages, if available. Unless these three samples conform to the strength requirements, no part of the lot shall be used.

7. Procedure

7.1 Preparation of Specimens for Capping—Use an abrasive stone to remove loose protrusions from the surfaces of the specimens to be capped. Refer to the appropriate compression test method (Test Methods C 140 or Test Method C 1314) for other specimen preparation requirements.

7.2 Capping Test Specimens—Cap top and bottom bearing surfaces of specimens by one of the methods in 7.2.1 or 7.2.2. Use alignment devices as needed to make sure the caps meet the requirements of 7.4.

NOTE 8—Various alignment devices have been demonstrated to be effective. For capping with sulfur materials, which sets quickly, alignment jigs make sure that the specimen is placed on the capping plate correctly in the first motion. For capping with gypsum cement materials, levels placed across the top of specimen have proven to work well. Bullseye levels work particularly well with smaller specimens.

7.2.1 Capping Using Gypsum Cement Materials—See Fig. 1 for capping setup. Spread the gypsum cement capping

material evenly on the capping plate or capping wear plate that has been lightly coated with oil or sprayed with a TFE-fluorocarbon coating (Note 9). Bring the surface of the specimen to be capped into contact with the capping material; firmly press down the specimen with a single motion, holding it so that its axis is at right angles to the capping surface to comply with the requirements of 7.4. Do not disturb the specimen until the capping material has solidified.

7.2.1.1 *Alternative Capping Method Using Gypsum Cement Materials*—See Fig. 1 for capping setup. Spread the gypsum cement capping material evenly on the top surface of the specimen. Bring the casting plate, which has been lightly coated with oil or sprayed with TFE-fluorocarbon coating (Note 9), into contact with the capping paste; firmly press down the plate with a single motion holding it so it is at right angles to the specimen. Within 30 s, lightly adjust the plate to achieve a resulting cap that will comply with the requirements of 7.4. Do not further disturb the specimen or casting plate until the capping material has solidified.

NOTE 9—The use of oil or TFE-fluorocarbon coatings on capping or casting plates is not necessary if it is found that the plate and specimen can be separated without damaging the cap.

NOTE 10—Generally, specimens can be removed from capping or casting plates after 30 min without damaging the cap. However, the length of time to assure setting of the cap will vary depending on a variety of factors such as the water-gypsum cement ratio used, environmental conditions, the properties of the specimen being capped, and the temperature of the mix water.

7.2.2 *Capping Using Sulfur Capping Materials:*

7.2.2.1 (**Warning**—Hydrogen sulfide gas is often produced during capping when sulfur capping material is contaminated with organic materials such as paraffin or oil. The gas is colorless and has a notoriously bad odor of rotten eggs; however, the odor is not a reliable warning sign, since the sensitivity to the odor disappears rapidly on exposure. High concentrations are lethal and less concentrated dosages may produce nausea, stomach distress, dizziness, headache, or irritation of the eyes. For this and other safety reasons, locate the capping station in a well-ventilated area and the melting pot under a hood with an exhaust fan.)

7.2.2.2 (**Warning**—Sulfur capping materials are used in a hot, molten state. Adequate protection is required to prevent contact with eyes, hands and other parts of the body.)

7.2.2.3 Heat the sulfur mixture in a thermostatically controlled heating pot to a temperature of 265 to 290°F (129 to 143°C) to maintain fluidity after contact with the capping surface. Verify sulfur capping material temperature using an

all-metal thermometer placed at the center of the mass. Verify temperature at hourly intervals during capping operations.

7.2.2.4 Empty the pot and recharge with fresh materials periodically to ensure that the oldest material in the pot has not been used more than five times. Fresh sulfur capping material shall be dry at the time it is placed in the pot as dampness may cause foaming. Keep water away from the molten sulfur capping material for the same reason.

7.2.2.5 Warm the capping plate before use to slow the rate of hardening of the molten sulfur capping material and to permit the production of thin caps. Lightly oil the surface of the capping plate (Note 9) and stir the molten sulfur capping material immediately prior to pouring each cap.

7.2.2.6 Form a rectangular mold on the capping plate whose dimensions are approximately ½ in. (13 mm) greater than the overall dimensions of the specimen. The mold must be sufficiently rigid to not move or deflect during the capping operation, and large enough to accommodate the specimen to be capped and the sulfur capping material without overflow. (See Note 11.) Fill the mold to a depth of ¼ in. (6 mm) with the hot sulfur compound. Bring the surface of the specimen to be capped quickly into contact with the liquid, holding the specimen so that its axis is at right angles to the surface of the capping liquid to achieve a resulting cap that will comply with the requirements of 7.4.

NOTE 11—The use of four 1-in. square steel bars has been found to be adequate for forming this capping mold.

7.2.2.7 Do not disturb the specimen until the sulfur compound has solidified and cooled.

7.3 Once the caps have solidified and, in the case of sulfur capping materials, cooled, separate the specimen from the capping or casting plates in such manner as to prevent damage to the caps and specimens.

7.4 Caps shall be perpendicular within 0.08 in. in 8 in. (2 mm in 200 mm) to the vertical axis of the specimen. The surfaces of the caps shall be plane within 0.003 in. in 16 in. (0.075 mm in 400 mm).

7.5 The average thickness of the cap shall not exceed ⅛ in. (3 mm).

7.6 Do not patch caps. Remove imperfect caps and replace with new ones. Do not test the specimens until the cap has achieved the desired strength based on qualification testing. Cap age shall be at least two hours.

8. Keywords

8.1 cap; capping; capping materials; capping plate; casting plate; compressive strength; gypsum cement; sulfur

SUMMARY OF CHANGES

Committee C15 has identified the location of selected changes to this standard since the last issue (C 1552 – 08) that may impact the use of this standard. (Approved Nov. 1, 2008.)

- (1) Added a requirement to **5.1.1** that the capping wear plate be level at the time of capping. (2) Added **Fig. 1** to clarify configuration when capping and when casting.

Committee C15 has identified the location of selected changes to this standard since the last issue (C 1552 – 07) that may impact the use of this standard. (Approved June 1, 2008.)

- (1) Revised **5.1** to allow the use of granite or diabase as a capping plate material. (2) Revised **7.2.2.6** in regards to sulfur capping molds.

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).