



# Standard Specification for Molds for Forming Concrete Test Cylinders Vertically<sup>1</sup>

This standard is issued under the fixed designation C 470/C 470M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope\*

1.1 This specification covers molds for use in forming cylindrical concrete specimens. The provisions of this specification include the requirements for both reusable and single-use molds.

NOTE 1—Sizes included are molds having diameters from 50 mm [2 in.] to 900 mm [36 in.].

1.2 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard. The inch-pound units are shown in brackets.

1.3 The following safety hazards caveat pertains only to the test method described in this specification: *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

1.4 The text of this standard references notes and footnotes which provide explanatory material. These notes and footnotes (excluding those in tables and figures) shall not be considered as requirements of the standard.

## 2. Referenced Documents

2.1 *ASTM Standards*:<sup>2</sup>

**C 31/C 31M** Practice for Making and Curing Concrete Test Specimens in the Field

**C 33** Specification for Concrete Aggregates

**C 192/C 192M** Practice for Making and Curing Concrete Test Specimens in the Laboratory

**D 256** Test Methods for Determining the Izod Pendulum Impact Resistance of Plastics

<sup>1</sup>This specification is under the jurisdiction of ASTM Committee C09 on Concrete and Concrete Aggregates and is the direct responsibility of Subcommittee C09.61 on Testing for Strength.

Current edition approved July 1, 2008. Published August 2008. Originally approved in 1961. Last previous edition approved in 2002 as C 470/C 470M-02a.

<sup>2</sup>For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

**D 570** Test Method for Water Absorption of Plastics

## 3. General Requirements

3.1 The following provisions apply to both reusable and single-use molds:

3.1.1 Molds shall be constructed in the form of right circular cylinders which stand with the cylindrical axis vertical and the top open to receive the concrete. They shall be made of materials that do not react with concrete containing portland or other hydraulic cements. They shall be watertight and sufficiently strong and tough to permit their use without tearing, crushing, or deforming.

NOTE 2—Reusable lids may be used on molds to reduce moisture loss.

3.1.2 Molds shall have a nominal inside height equal to twice the nominal inside diameter. The diameter of a mold, consisting of the average of two measurements taken at right angles to each other at the top of the mold, shall not differ from the nominal diameter by more than 1 %. The height, determined by averaging two measurements taken 180° apart, shall not differ from the nominal height by more than 2 %. The planes of the top rim of the mold and the bottom shall be perpendicular to the axis of the mold within 0.5 degrees—approximately equivalent to 3 mm in 300 mm [ $\frac{1}{8}$  in. in 12 in.]. No diameter of a mold shall differ from any other diameter of the same mold by more than 2 % except that molds that fail to meet this requirement may be used when the user is able to demonstrate that no diameter of hardened concrete specimen produced in a similar mold differs from any other diameter on the same specimen by more than 2 % (see **Note 3**).

NOTE 3—Certain single-use molds may require the use of a special device such as a tube of heavy-gage metal around the mold during molding to maintain the dimensional tolerances specified in **3.1.2**.

3.1.3 The bottom inside surface of the mold shall not depart from a plane by more than 2 mm in 150 mm [ $\frac{1}{16}$  in. in 6 in.] (1 % of the diameter of the mold).

## 4. Reusable Molds

4.1 Reusable molds are those which are designed to be used more than a single time. Reusable molds shall be made of nonabsorptive materials, and constructed as either one piece or several pieces (see **Note 4**).

\*A Summary of Changes section appears at the end of this standard.

4.2 Reusable molds shall be provided with a closure or base on the lower end at right angles to the axis of the cylinder. Molds may be single piece molds or made from castings with a separate detachable base plate or a base that is an integral part of the sidewall. The mold shall be either coated or made of a material that will prevent adherence to the concrete. At the time of use, molds shall not leak water. An inside fillet, if any, at the bottom of the side wall shall have an indentation around the circumference no more than 3 mm [ $\frac{1}{8}$  in.] in the vertical direction or no more than 5 mm [ $\frac{3}{16}$  in.] in the horizontal direction.

4.3 Reusable molds shall be tested for water leakage as described in 6.4, for resistance to damage as described in 6.3.1, and for dimensional stability in accordance with 3.1.2 and 3.1.3 after every 50 uses or every six months, whichever comes first.

NOTE 4—Satisfactory molds can be made from lengths of steel tubing or pipe that is slit on one side parallel to the axis and fitted with a means of closing the vertical slit as well as a means of attaching a base plate. The required dimensional tolerances must be maintained after slitting, clamping, and attaching the base plate. Other nonabsorptive materials which have been used include iron, brass, steel, and various plastics. Although aluminum and magnesium alloys have been used, some of these alloys may be reactive with cement constituents and are therefore unacceptable.

## 5. Single-Use Molds

5.1 Single-use molds are molds designed to be used once and discarded. They are permitted to be made of sheet metal, plastic, suitably treated paper products, or other materials and shall conform to the requirements of this specification.

5.2 *Physical Requirements*—The molds as prepared for use shall comply with the following:

5.2.1 *Water Leakage*—When tested as described in Section 6, there shall be no visible leakage.

5.2.2 *Absorptivity*—When tested as described in Section 6, the absorption shall not exceed the values given in Table 1. Intermediate values are proportional to the square of the height.

5.2.3 *Elongation*—When tested as described in Section 6, the elongation after test shall not exceed 0.2 % of height.

5.3 *Single-use Plastic Molds*—Molds shall conform to the following additional requirements when plastic is the predominant material used in construction:

5.3.1 *Wall Thickness*—The side walls shall be of sufficient stiffness to meet the requirements of 3.1 (See Note 5).

NOTE 5—This can be achieved through sufficient side wall thickness alone, or in combination with a stiffened top.

5.3.2 *Bottom Design*—The bottom shall be designed so that it will be flush with the bottom of the sidewall within a tolerance of 2 mm [ $\frac{1}{16}$  in.]. An inside fillet, if any, at the

bottom of the sidewall shall have an indentation around the circumference no more than 4 mm [ $\frac{1}{8}$  in.] in the vertical direction or no more than 5 mm [ $\frac{3}{16}$  in.] in the radial direction. The bottom shall be of adequate rigidity to prevent permanent deformation when specimens are molded in accordance with the applicable provisions of Practice C 31/C 31M or C 192/C 192M.

5.3.3 *Material*—The mold manufacturer shall certify that: (1) the plastic material used in molds has a maximum water absorption of less than 0.5 % in 24 h when tested in accordance with Test Method D 570; (2) the plastic has an Izod impact toughness of at least 117 J/m [2.2 ft lb/in.] of notch for a 4 mm [ $\frac{1}{8}$  in.] thick specimen tested in accordance with Test Methods D 256; and (3) after being held at 12 °C [10 °F] for 24 h, the plastic shall not fracture when subject to tapping and jarring that is judged to be typical of what occurs when specimens are molded in accordance with the applicable provisions of Practice C 31/C 31M or C 192/C 192M.

5.4 *Paper Molds*—When paper or other potentially absorptive fiber material is used as the primary structural material in the construction of the side walls or bottom of the mold, the mold shall conform to the following additional requirements:

5.4.1 *Side Walls*—The side walls of paper molds shall be made with a minimum of three plies having a combined thickness of not less than 2 mm [0.070 in.]. Seams on the inside of the mold shall not be open by more than 2 mm [ $\frac{1}{16}$  in.].

NOTE 6—The minimum thickness of material used in side walls and bottoms is considered adequate for cylinders up to 150 mm [6 in.] in diameter. For larger cylinders thicker material may be required to meet requirements of 3.1.

5.4.2 *Bottom Caps*—The bottom cap of the mold shall be made of either metal or paper. If metal, it shall not be less than 0.23 mm [0.009 in.] in thickness and coated to prevent corrosion (Note 6). It shall be designed so that it will be flush with the bottom edge of the side wall within a tolerance of 2 mm [ $\frac{1}{16}$  in.] and the inside crimp, if any, shall produce an indentation around the circumference of the cylinder no more than 5 mm [ $\frac{3}{16}$  in.] in the radial, and no more than 4 mm [ $\frac{1}{8}$  in.] in the vertical direction. If made of paper, the bottom cap of the mold shall be of parchment-lined cap stock not less than 0.7 mm [0.028 in.] thick (Note 6). It shall be glued to the outside of the walls by means of a flange not less than 19 mm [ $\frac{3}{4}$  in.] high. The glue shall be water-insoluble adhesive of the resin type that will not react with fresh concrete. Only the practicable minimum amount of adhesive shall be exposed on the inner side of the bottom of the mold.

5.4.3 *Waterproofing*—The mold made from paper or fiber shall be completely coated on inside and outside, side walls, and bottom with a suitable waterproofing medium (Note 7). The top edge shall be waterproofed, or coated, to limit absorption. The surfaces of metal bottoms, which must comply with 5.4.2, need not be coated. Any waterproofing coating used in this application shall have a melting point not less than 49 °C [120 °F] (Note 8). The coating shall provide a film over the inside that will minimize adherence of the concrete to the side walls and the bottom.

NOTE 7—Paraffin coating for this use may be of the grade known to the trade as crude scale wax or of any superior grade. In general, a film of

**TABLE 1 Limits for Absorption and Elongation**

Nominal Mold Height, mm [in.]	Absorption, max g	Elongation, max mm [in.]
100 [4]	2.7	0.2 [0.008]
150 [6]	6.0	0.3 [0.012]
200 [8]	11	0.4 [0.016]
300 [12]	24	0.6 [0.024]
450 [18]	54	0.9 [0.036]
600 [24]	96	1.2 [0.048]
900 [36]	216	1.8 [0.072]

paraffin of sufficient thickness to accomplish the intended purposes will permit one to raise a curl of paraffin with the thumbnail.

NOTE 8—Such coatings may be unsuitable for molds that are subjected to temperatures above 49 °C [120 °F], either before or after filling with concrete.

5.5 *Single-Use Sheet Metal Molds*—Molds shall conform to the following additional requirements when light-gage sheet metal is the predominant material used in their construction:

5.5.1 *Metal Thickness*—The side wall of steel sheet metal molds shall be manufactured from sheet metal not thinner than can-making quality blackplate and shall have a minimum metal thickness corresponding to that of 48.5-kg [107-lb] blackplate, which is approximately 0.300 mm [0.0118 in.] thick or 30½ gage. The metal for the bottom of the mold shall have a minimum thickness of 0.23 mm [0.009 in.] (Note 6).

5.5.2 *Bottom Design*—The bottom shall be so designed that it will be flush with the bottom of the side wall within a tolerance of 2 mm [⅛ in.]. An inside crimp, if used, shall produce an indentation around the circumference of the cylinder no more than 4 mm [⅛ in.] in the vertical or 5 mm [¾ in.] in the radial direction.

5.5.3 *Top Edge*—The top edge of the side wall shall be curled or beaded to strengthen the mold and protect the user from sharp edges. If such bead protrudes to the inside of the mold, the indentation produced in the concrete cylinder shall not exceed 4 mm [⅛ in.] in either a radial or vertical direction.

5.5.4 *Coating*—If the mold is made of material which will rust, corrode, react, or adhere to the freshly mixed or hardened concrete, it must be coated with a protective coating of lacquer or other suitable material.

## 6. Test Methods for Elongation, Absorption, and Water Leakage

6.1 *Apparatus*—The assembly used for the absorption-elongation test shall follow the principles illustrated in Fig. 1.


6.2 *Specimens*—Molds shall be selected as described in Section 2. Single-use molds shall not be reused nor the same mold retested.

### 6.3 Test Procedure for Molds:

6.3.1 Samples of all types of single-use molds and reusable plastic molds shall be subjected to the dry rodded coarse aggregate test as described in 6.3.2 to evaluate their resistance to damage under use and to the water leakage test described in 6.3.3 and 6.3.4. Paper or other potentially absorptive molds shall additionally be tested for absorptivity and elongation described in 6.3.5. Plastic and sheet metal molds need not be tested for elongation and absorption, but should be tested for water leakage. Dimensional requirements for all molds shall be verified.

6.3.2 Prepare the mold for test by filling with dry crushed stone coarse aggregate meeting the grading requirements of Specification C 33 size No. 57, 25.0 to 4.75 mm [1 in. to No. 4] or No. 67, 19.0 to 4.75 mm [¾ in. to No. 4]. Fill and compact the mold by the rodding procedure specified in Practice C 192/C 192M for compression test specimens using the tamping rod, number of layers and number of strokes per layer specified. It will generally not be possible to obtain the penetration of the tamping rod specified in Practice C 192/C 192M. After rodding the final layer, empty the coarse aggregate, wipe lightly with a dry cloth and examine the mold for physical damage.

6.3.3 After completion of 6.3.2, determine the mass of the mold and record to the nearest 0.004 g/mm [0.1 g/in.] of mold height. Place the mold on a firm, flat surface and fill with water at room temperature to a depth of 90 to 95 % of the mold height. Then place the mold on the dial stand, cover with the glass or metal plate and record the initial length by dial micrometer to the nearest 0.025 mm [0.001 in.].

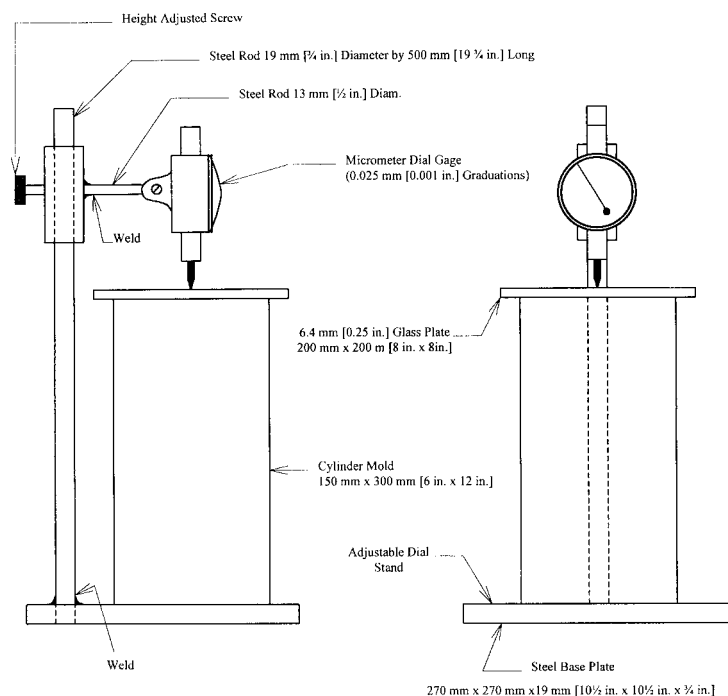

**FIG. 1 Apparatus for Absorption-Elongation Test of Paper Molds**

6.3.4 Allow the mold to stand for 3 h and take a final reading of the micrometer. Examine and record any visible leakage. Empty water from the mold, dry lightly with a towel and record the final mass to the nearest 0.04 g/cm [0.1 g/in.] of mold height.

6.3.5 Calculate the elongation as the difference between the final length and initial length. Calculate the absorption as the difference between the final mass and initial mass of the mold.

6.3.6 Verify all dimensional requirements.

6.4 *Water Leakage Test for Reusable Molds:*

6.4.1 Prepare reusable molds with the sealant to be used, if required. Fill molds with water to a depth of 90 to 95 % of the nominal height. Subject the mold to tapping and jarring which is judged to be typical of what occurs when specimens are molded in accordance with the applicable provisions of Practice **C 31/C 31M** or **C 192/C 192M**.

6.4.2 One hour after tapping, examine for visible leakage.

## 7. Sampling and Rejection

7.1 At least three single-use and reusable molds shall be selected at random from each shipment by the purchaser to ensure that the molds are in compliance with this specification.

7.2 Failure of any one of the three molds to comply with this specification shall be basis for rejection of the shipment.

## 8. Report to be Prepared by the Purchaser

8.1 Where applicable for the type of mold tested, report the following information for each mold tested:

- 8.1.1 Brand or source of molds,
- 8.1.2 Shipment or lot from which the mold was taken,
- 8.1.3 Date sampled and date tested,
- 8.1.4 Brief general description of the mold including nominal dimensions, type of mold, and materials of which it is made,
- 8.1.5 Total absorption, g, if specified,
- 8.1.6 Total expansion, mm [in.], if specified, and
- 8.1.7 Water leakage reported in terms of compliance, or failure by leakage.

8.2 Where applicable for the type of mold tested, report the following information for samples which do not meet the requirements of the specification:

- 8.2.1 Average diameter or height, mm [in.],
- 8.2.2 Maximum and minimum diameters or heights, mm [in.],
- 8.2.3 Nonconformance with required perpendicularity of rim or base to the axis of the mold,
- 8.2.4 Apparent reaction between mold materials and concrete or mortar or corrosion of metal in contact with concrete,
- 8.2.5 Melting point less than 49 °C [120 °F],
- 8.2.6 Minimum thickness of materials in side walls or bottom, and
- 8.2.7 Dimension of crimp in bottom, top edge or construction of paper bottom.

## 9. Keywords

- 9.1 concrete; molds; test cylinders

## SUMMARY OF CHANGES

Committee C09 has identified the location of selected changes to this specification since the last issue, C 470/C 470M – 02a, that may impact the use of this specification. (Approved July 1, 2008)

- (1) Deleted old Fig. 1 and renumbered subsequent figures. Deleted references to old Fig. 1 throughout.
- (2) Deleted “Assembled” from 6.4. Changed “Assemble” to

- “Prepare” and pluralized “provision” in 6.4.1.
- (3) Revised 5.1 to provide an explicit definition of a single-use mold and to meet requirements for mandatory language.

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).*