

© British Standards Institution. No part of this publication may be photocopied or otherwise reproduced without the prior permission in writing of BSI.

British Standard

Testing concrete

Part 101. Method of sampling fresh concrete on site

Essais du béton

Partie 101. Méthode d'échantillonnage du béton frais au chantier

Prüfverfahren für Beton

Teil 101. Verfahren zur Probetahme von Frischbeton auf der Baustelle

Contents

	Page		Page
Foreword		Appendix	
Committees responsible	Inside front cover Back cover	A. Certificate of sampling	3
Method		Table	
1. Scope	1	1. Quantities of concrete required	2
2. Definitions	1	Figure	
3. Apparatus	1	1. scoop	1
4. Sampling procedure	1		
5. Certificate of sampling	2		
6. Determination of sampling error	2		

Foreword

This part of this British Standard, prepared under the direction of the Cement, Gypsum, Aggregates and Quarry Products Standards Committee, is a revision of clause 2 of BS 1881 : Part 1 : 1970 which has been deleted by Amendment No. 1 to that standard.

This Part describes methods of sampling from concrete mixes of all workabilities, advice being included for the sampling of very high workability concrete including mixes produced by the use of superplasticizers. Sampling in accordance with this standard will comply with the proposed international standard ISO 2736 : Part 1*.

An alternative method of sampling is permitted for the measurement of slump of concrete delivered in a truck.

In such a case, the sample is obtained from the initial discharge of concrete from the truck. This alternative method given in BS 1881 : Part 102 is only permitted for the slump test as no data are available at the present time for its use for other methods of test given in this standard.

No guidance is given in this Part of this standard for the number of specimens required for testing. Information in this respect may be found in other standards, e.g. BS 5328.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

*In course of preparation.

British Standard

Testing concrete

Part 101. Sampling fresh concrete on site

1. Scope

This Part of this British Standard describes methods to be used on site for obtaining from a batch of fresh concrete representative samples of the quantity required for carrying out the tests and making test specimens in accordance with other Parts of this British Standard together with a procedure for determining sampling errors using cube compressive strength test results. The methods specified apply to concrete made with aggregate having a nominal maximum size of no more than 40 mm and are suitable for very low, low, medium and high workability concretes up to a workability represented by 150 mm nominal slump. (For mixing and sampling in the laboratory, see BS 1881 : Part 1 : 1970').

NOTE. The titles of the publications referred to in this standard are listed on the inside back cover.

2. Definitions

For the purposes of this Part of this British Standard, the definitions given in BS 5328 apply together with the following.

2.1 batch. The quantity of concrete mixed in one cycle of operations of a batch mixer, or the quantity of concrete conveyed ready-mixed in a vehicle, or the quantity discharged during 1 min from a continuous mixer.

2.2 sample. A quantity of concrete, consisting of a number of standard scoopfuls, taken from a batch of concrete whose properties are to be determined.

2.3 standard scoopful. The quantity of concrete taken by a single operation of the scoop, approximately 5 kg mass of normal weight concrete.

2.4 sampling error. The random error arising from inevitable deficiencies in a sampling procedure.

NOTE. An acceptable sampling error is one which does not lead to a significant loss in accuracy and precision of testing.

3. Apparatus


3.1 Scoop, made from minimum 0.8 mm thick non-corrodible metal suitable for taking standard scoopfuls of concrete.

NOTE. A suitable scoop is shown in figure 1.

3.2 Container for receiving concrete from the scoop, made of plastics or metal, of 9 L minimum capacity.

3.3 Sampling tray, 1.2 m x 1.2 m x 50 mm deep made from minimum 1.6 mm thick non-corrodible metal. (For use in determination of sampling error, see clause 6.)

3.4 Square mouthed shovel, size 2 in accordance with BS 3388. (For use in determination of sampling error, see clause 6.)

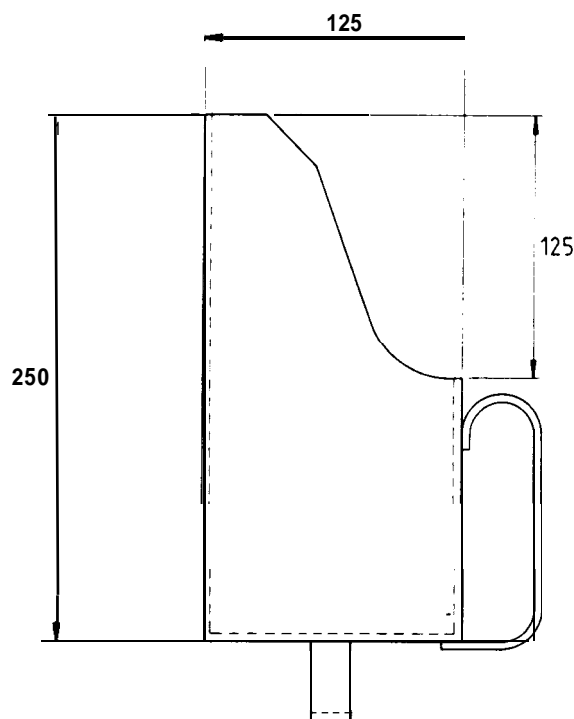

All dimensions are in millimetres.

Figure 1. Scoop

4. Sampling procedure

4.1 Sampling plan. Calculate the number of scoopfuls required for the test(s) by reference to table 1. Nominally divide the batch to be sampled into this number of parts, each part being approximately equal in quantity. When sampling from a batch mixer or ready-mixed concrete truck disregard the very first part and very last part of the discharge. If the batch to be sampled has been deposited in a heap or heaps of concrete, the parts should wherever possible be distributed through the depth of the concrete as well as over the exposed surface.

NOTE. When sampling from a ready-mixed concrete truck the division into parts can be on the basis of a given number of discharging revolutions of the drum. See also BS 1881 : Part 102 for an alternative method of sampling for the slump test.

4.2 Obtaining the sample. Ensure that the apparatus is clean. Using the scoop obtain a scoopful of concrete from the central portion of each part of the batch and place in the container or containers. When sampling from a falling stream pass the scoop through the whole width and thickness of the stream in a single operation. Take the container(s) to the area where the sample is to be prepared for testing or mould filling.

NOTE. Modifications may be necessary when obtaining samples of very high workability concrete (e.g. superplasticized concrete). A larger scoop than the standard scoop may be required to collect a scoopful of nominal 5 kg mass without spillage. Alternatively, a larger number of standard scoopfuls may be taken to obtain the required mass of concrete.

4.3 Protection of samples. At all stages of sampling, transport and handling, the fresh concrete samples shall be protected against gaining or losing water and against excessive temperatures.

Table 1. Quantities of concrete required

Test or specimen	No. of standard scoopfuls
Slump	4
Compacting factor	6
Vebe time	4
Flow index	4
Air content	4
Density	6
100 mm cube (per pair of cubes)	4
150 mm cube (per pair of cubes)	4
100 mm x 100 mm x 500 mm beam (per pair of beams)	6
150 mm x 150 mm x 750 mm beam (per pair of beams)	18
150 mm x 300 mm long cylinder (per pair of cylinders)	6
100 mm x 200 mm long cylinder (per pair of cylinders)	4
75 mm x 75 mm x 300 mm prism (per pair of prisms)	4
150 mm x 150 mm long cylinders (per pair of cylinders)	4

NOTE. For tests on concrete of very high workability, such as superplasticized concrete, see 4.2.

5. Certificate of sampling

Each sample shall be accompanied by a certificate from a person responsible for taking the sample stating that sampling was carried out in accordance with this British Standard. The certificate shall include the following:

- date and time of sampling;
- name of works;
- location in the works of the concrete which the sample represents;
- location of sampling (e.g. on discharge from truck or from a heap of concrete);
- delivery note number or other means of identifying the batch;
- sample identity number;
- ambient temperature and weather conditions;
- name of sampler;
- signature of person responsible for sampling.

NOTE. A standard certificate is shown in appendix A.

6. Determination of sampling error

6.1 General. The determination of sampling error is intended to provide a monitor of regular sampling or to assess the suitability of the standard method of sampling in unusual circumstances or for unusual materials.

Sampling error is assessed during regular sampling from the difference in compressive strength between duplicate samples with allowance for the contribution from testing error.

6.2 Procedure

6.2.1 General. From each of 20 batches of concrete of the same grade or mix obtain a standard sample and a duplicate sample using the procedure in clause 4. Each scoopful taken for the standard sample shall be followed immediately by a scoopful for the duplicate sample and the two samples shall be collected in separate containers. Prepare both the standard and the duplicate samples in accordance with 6.2.2 and make pairs of 150 mm cubes from each sample in accordance with BS 1881 : Part 108. Test all cubes for compressive strength at 28 day age in accordance with BS 1881 : Part 116.

6.2.2 Preparing the sample for test. Empty the sample from the container(s) onto the sampling tray. Ensure that no more than a light covering of slurry is left adhering to the container(s).

Thoroughly mix the sample by shovelling it to form a cone on the sampling tray and turning this over with the shovel to form a new cone, the operation being carried out three times. When forming the cones deposit each shovelful of the material on the apex of the cone so that the portions which slide down the sides are distributed as evenly as possible and so that the centre of the cone is not displaced. Flatten the third cone by repeated vertical insertion of the shovel across the apex of the cone, lifting the shovel clear of the concrete after each insertion.

NOTE. The following modifications to the mixing procedure may be necessary when preparing samples of very high workability concrete (e.g. superplasticized concrete) for test.

- Sampling tray.** The vertical lips on the edges of the tray may have to be larger to contain the sample without spillage during mixing.
- Mixing the sample.** The coning procedure is not suitable for very high workability concrete and the following alternative method of mixing is recommended. Having poured the concrete onto the sampling tray, use the shovel to turn the concrete from the outside toward the centre, working progressively once round all sides of the sampling tray.

6.3 Calculation and reporting sampling error. For each pair of compressive strength results from the 20 standard samples calculate the mean, M_s , and the differences, D_s . Similarly for each pair of compressive strength results from the 20 duplicate samples calculate the mean, M_d , and the differences, D_d . Record each calculation of the mean to the nearest 0.25 N/mm²

Calculate the following:

$$\text{Testing variance } (V_t) = \frac{D_s^2 + D_d^2}{80}$$

$$\text{Testing plus sampling variance } (V_{ts}) = \frac{(M_s - M_d)^2}{40}$$

$$\text{Mean strength } (M) = \frac{M_s + M_d}{40}$$

$$\text{Sampling error (in per cent)} = \frac{100 V_{ts} - 0.5 V_t}{M}$$

$$\text{Testing error (in per cent)} = \frac{100 V_t}{M}$$

Report sampling error and testing error to the nearest 0.1 %.

6.4 Assessment. If the estimate of the sampling error is greater than 3 %, then the sampling procedure shall be appraised. If the estimate of the testing error is above 3 %, then the testing procedure shall be appraised. If both estimates are less than 3 %, the sampling procedure can be assumed to be satisfactory.

Appendix A

Certificate of sampling

The following is a standard certificate of sampling in accordance with this Part of this standard.

CERTIFICATE OF SAMPLING IN ACCORDANCE WITH BS 1881 : PART 101

Date and time of sampling

Name of works

Location in works of the concrete
which the sample represents

Location of sampling (e.g. on discharge
from truck or from a heap of concrete)

Delivery note number or other means
for identifying the batch number

Sample identity number

Ambient temperature and weather conditions

Name of sampler

The sampler certifies that sampling was done in accordance with BS 1881 : Part 101

Signature of person responsible for sampling

Publications referred to

- BS 1881 Testing concrete
 - Part 1 Methods of mixing and sampling fresh concrete in the laboratory
 - Part 102 Method for determination of slump
 - Part 108 Method for making concrete test cubes
 - Part 118 Method for determination of compressive strength of concrete cubes
 - Part 125 Mixing and sampling fresh concrete in the laboratory
- BS 3388 Forks, shovels and spades
- BS 5328 Methods for specifying concrete, including ready-mixed concrete

*In course of preparation.

This British Standard, having been prepared under the direction of the Cement, Gypsum, Aggregates and Quarry Products Standards Committee, was published under the authority of the Board of BSI and comes into effect on 31 May 1983.

© British Standards Institution, 1983

ISBN 0 580 11921 1

The following BSI references relate to the work on this standard:
Committee reference CAB/4 Draft for comment 81/12319 DC

British Standards Institution. Incorporated by Royal Charter, BSI is the Independent national body for the preparation of British Standards. It is the UK member of the International Organization for Standardization and UK sponsor of the British National Committee of the International Electrotechnical Commission.

In addition to the preparation and promulgation of standards, BSI offers specialist services including the provision of information through the BSI Library and Standardline Database; Technical Help to Exporters; and other services. Advice can be obtained from the Enquiry Section, BSI, Milton Keynes MK14 6LE, telephone 0908 221166, telex 825777.

Copyright. Users of British Standards are reminded that copyright subsists in all BSI publications. No part of this publication may be reproduced in any form without the prior permission in writing of BSI. This does not preclude the free use, in the course of

implementing the standard, of necessary details such as symbols and size, type or grade designations. Enquiries should be addressed to the Publications Manager, BSI, Linford Wood, Milton Keynes MK14 6LE. The number for telephone enquiries is 0908 220022 and for telex 825777.

Contract requirements. A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Revision of British Standards. British Standards are revised, when necessary, by the issue either of amendments or of revised editions. It is important that users of British Standards should ascertain that they are in possession of the latest amendments or editions.

Automatic updating service. BSI provides an economic, individual and automatic standards updating service called PLUS. Details are available from BSI Enquiry Section at Milton Keynes, telephone 0908 221166, telex 825777.

Information on all BSI publications is in the BSI Catalogue, supplemented each month by *BSI News* which is available to subscribing members of BSI and gives details of new publications, revisions, amendments and withdrawn standards. Any person who, when making use of a British Standard, encounters an inaccuracy or ambiguity, is requested to notify BSI without delay in order that the matter may be investigated and appropriate action taken.

Committees responsible for this British Standard

This British Standard was published under the direction of the Cement, Gypsum, Aggregates and Quarry Products Standards Committee CAB/ - . Its preparation was entrusted to Technical Committee CAB/4 upon which the following bodies were represented:

British Aggregate Construction Materials Industries
British Precast Concrete Federation Ltd.
British Ready Mixed Concrete Association
Cement Admixtures Association
Cement and Concrete Association
Cement Makers' Federation
Concrete Society Limited
County Surveyor's Society
Department of the Environment (PSA)
Department of the Environment (Building Research Establishment)
Department of the Environment (Transport and Road Research Laboratory)
Department of Transport
Electricity Supply Industry in England and Wales

Federation of Civil Engineering Contractors
Greater London Council
Institute of Concrete Technology
Institution of Civil Engineers
Institution of Highway Engineers
Institution of Municipal Engineers
Institution of Structural Engineers
Institution of Water Engineers and Scientists
National Federation of Building Trades Employers
Royal Institute of British Architects
Royal Institution of Chartered Surveyors
Sand and Gravel Association Limited
Society of Chemical Industry

The following bodies were also represented in the drafting of the standard, through subcommittees and panels:

British Civil Engineering Test Equipment Manufacturers' Association
Coopted members

Amendments issued since publication

Amd. No.	Date of issue	Text affected

**Amendment No. 1
published and effective from 31 July 1989
to BS 1881 : Part 101 : 1983**

**Testing concrete
Part 101. Method of sampling fresh
concrete on site**

Revised text

AMD 6091
July 1989

Clause 3.3 Sampling tray

Delete this clause and substitute the following.

'3.3 Sampling tray, minimum dimensions 900 mm x 900 mm x 50 mm deep, of rigid construction and made from a non-absorbent material not readily attacked by cement paste. (For use in the determination of sampling error, see clause 6.)

NOTE. A larger size may be necessary for high workability concrete and when preparing samples for casting beams.'

AMD 6091
July 1989

Clause 4.2 Obtaining the sample

At the end of this clause insert the following.

'Caution. When cement is mixed with water, alkali is released. Take precautions to avoid dry cement entering the eyes, mouth and nose when mixing concrete. Prevent skin contact with wet cement or concrete by wearing suitable protective clothing. If cement or concrete enters the eye, immediately wash it out thoroughly with clean water and seek medical treatment without delay. Wash wet concrete off the skin immediately.'

AMD 8091
July 1989

Clause 6.3 Calculation and reporting sampling error

Delete the fourth equation and substitute the following.

$$\text{'Sampling error (in per cent) = } \frac{100 (V_{ts} - 0.5 V_t)'}{M}$$

blank