
British Standard

Testing concrete

**Part 117. Method for determination of
tensile splitting strength**

Essais du béton

Partie 117. Méthode de détermination de la résistance à la traction par fendage

Prüfverfahren für Beton

Teil 117. Bestimmung der Spaltzugfestigkeit



S

Contents

	Page		Page
Foreword	Inside front cover	5. Procedure	2
Cooperating organizations	Back cover	6. Calculation and expression of results	2
		7. Test report	2
Method		Figures	
1. Scope	1	1. Suitable jigs for the tensile splitting strength test	3
2. Definitions	1	2. Plane of loading	4
3. Apparatus	1		
4. Test specimens	1		

Foreword

This Part of this British Standard, prepared under the direction of the Cement, Gypsum, Aggregates and Quarry Products Standards Committee, is a revision of clause 7 of BS 1881 : Part 4 : 1970. Together with Parts 116, 117, 118, 119 and 120, this Part of BS 1881 supersedes BS 1881 : Part 4 : 1970 which is withdrawn.

This Part of this standard describes one procedure for the determination of tensile splitting strength, with the option of using one of two sets of apparatus. Use of the procedure with one set of apparatus is derived from ISO 4108 which gives a tensile splitting strength test for cylindrical, cubic and prismatic specimens. Use of the procedure with the

other set of apparatus is for cubic and prismatic specimens. Using the procedure with the alternative sets of apparatus cannot be expected to give equivalent results.

A typical estimate of repeatability for the test on 150 mm diameter \times 309 mm long cylindrical specimens only is included. No estimate is given for other specimens or for reproducibility. Reference should be made to BS 5497 : Part 1 for further information on the determination of repeatability and reproducibility.

Compliance with a British Standard does not of itself confer immunity from legal obligations.



Amendment No. 1
published and effective from 31 July 1989
to BS 1881 : Part 117 : 1983

Testing concrete
Part 117. Method for determination
of tensile splitting strength

Revised text

AMD 6096
 July 1989

Foreword

In paragraph 1, line 4, before '116' insert '115, ' and delete '117'.

AMD 6096
 July 1989

Clause 4.1 Sampling

In line 2 delete the dagger footnote mark and the associated footnote and substitute 'or Part 125'.

AMD 6096
 July 1989

Publications referred to

Under BS 1881 delete 'Part 1 Methods of sampling fresh concrete'; for Part 101 delete the asterisk and the associated footnote; finally, insert 'Part 125 Methods for mixing and sampling fresh concrete in the laboratory'.



blank

British Standard

Testing concrete

Part 117. Method for determination of tensile splitting strength

1. Scope

This Part of this British Standard describes the method for the determination of the indirect tensile splitting strength of cylindrical, cubic and prismatic concrete test specimens.

NOTE. The titles of the publications referred to in this Part of this standard are listed on the inside back cover.

2. Definitions

For the purposes of this Part of this standard the definitions given in BS 5328 and BS 5497 : Part 1 apply.

3. Apparatus

3.1 General. Either apparatus A* for splitting cylindrical, cubic and prismatic specimens or alternatively apparatus B for splitting cubic and prismatic specimens shall be used.

3.2 Components of apparatus A and apparatus B

3.2.1 *Testing machine.* The testing machine shall comply with BS 1881 : Part 115.

3.2.2 *Jig.* Suitable jigs are shown in figure 1. The jig and/or the machine shall have a device to position the jig correctly on the lower platen, with the specimen central.

3.3 Components of apparatus A

3.3.1 *Packing strips.* Use hardboard packing strips between the specimen and jigs or steel loading pieces. Packing strips shall be of oil tempered grade hardboard complying with BS 1142 and shall be used only once. They shall have the following dimensions (see figures 1 (a) and (b)).

width: $a = 15 \pm 2 \text{ mm}$;
 thickness: $t = 4 \pm 1 \text{ mm}$;
 length: greater than the length of the line of contact of the test specimen.

3.3.2 *Steel loading pieces.* Place a steel loading piece between the platen of the machine and the hardboard packing strip. This piece shall not be shorter than the specimen. For cylindrical specimens it shall be of rectangular cross-section. For cubic and prismatic specimens, it shall be a section of a cylinder, with a

radius of 75 mm, so that the load is applied along a line on the surface of the specimen (see figures 1 (a) and (b)). This loading piece can be incorporated within the jig. The tolerances on the dimensions shall be as specified in 3.5.

3.4 Components of apparatus B

3.4.1 *Steel loading pieces.* Steel loading pieces shall be auxiliary platens incorporating steel strips with the following dimensions (see figure 2 (c)):

width : $a = 6 \pm 1 \text{ mm}$ for 150 mm size specimens,
 $4 \pm 1 \text{ mm}$ for 100 mm size specimens;
 thickness: $t = 4 \pm 1 \text{ mm}$;
 length: not less than the length of the line of contact with the test specimen.

The tolerances on the dimensions shall be as specified in 3.5.

3.5 Tolerances. The steel loading pieces specified in 3.3.2 and 3.4.1 shall have the flatness, parallelism and surface requirements along the length of the strips within the tolerances for auxiliary platens given in BS 1881 : Part 115.

The steel loading pieces shall be replaced when the dimensions are out of tolerance or they are seriously damaged or pitted along the contact face.

4. Test specimens

4.1 *Sampling.* Sampling of the concrete shall be carried out in accordance with BS 1881 : Part 101†.

4.2 *Preparation.* Test specimens shall be made in moulds cured and stored in accordance with the relevant Parts of this standard.

NOTE. Cylindrical test specimens of 150 mm diameter X 150 mm long are preferred. For cubical and prismatic specimens, the cross section dimension of 150 mm is preferred.

4.3 *Mass.* Weigh each specimen, as-received or saturated, in accordance with BS 1881 : Part 114.

4.4 *Dimensions.* Check the nominal dimensions and take measured dimensions of each specimen in accordance with BS 1881 : Part 114.

4.5 *Density.* Determine the density of each specimen in accordance with BS 1881 : Part 114.

*Apparatus A is based on that given in ISO 4108.

†In course of preparation. Until Part 101 is published, reference should be made to Part 1.

5. Procedure

5.1 Preparation for testing. Wipe clean the bearing surfaces of the testing machine, of the steel loading pieces and of the packing strips; remove any loose material from the surfaces of the test specimen which are to be in contact with the packing strips.

5.2 Positioning of the test specimen (see figure 1). Place the test specimen in the centring jig with packing strips and/or loading pieces carefully positioned along the top and bottom of the plane of loading of the specimen. Then place the jig in the machine so that the specimen is located centrally. In the case of prismatic and cubic specimens, the load shall be applied on the moulded faces in such a way that the fracture plane will cross the trowelled surface (see figure 2). Ensure that the upper platen is parallel with the lower platen with cylindrical specimens.

5.3 Loading. Without shock, apply and increase the load continuously at a nominal rate within the range 0.02 N/(mm² .s) to 0.04 N/(mm² .s). Maintain the rate, once adjusted, until failure. On manually controlled machines as failure is approached the loading rate will decrease; at this stage operate the controls to maintain as far as possible the specified loading rate. Record the maximum load applied to the specimen. The rate of increase of load may be calculated from the formula:

$$(0.02 \text{ to } 0.04) \times \frac{\pi}{2} \times l \times d \text{ N/s}$$

6. Calculation and expression of results

6.1 Calculation and expression of results. The tensile splitting strength σ_t in N/m² is given by the formula:

$$\sigma_t = \frac{2F}{p \times l \times d}$$

where

F is the maximum load (in N);

l is the length of the specimen as shown in figure 2 (in mm);

d is the cross-sectional dimension of the specimen as shown in figure 2 (in mm).

Express the tensile splitting strength to the nearest 0.05 N/mm².

6.2 Precision. For pairs of 150 mm diameter x 300 mm long cylinders, made from the same sample, cured in similar conditions and tested in accordance with this Part of this standard, the repeatability expressed as a percentage of the mean of the two strengths obtained, is 18 % at the 95 % probability level (see BS 5497 : Part 1).

7. Test report

7.1 General. The report shall affirm that the tests were made in accordance with this Part of this standard. The report shall also state whether or not certificates of sampling, specimen preparation and curing are available. If available, a copy of each certificate shall be provided.

7.2 Information to be provided by the producer of the test specimens

7.2.1 *Mandatory information.* The following information shall be provided by the producer of the test specimens for inclusion in the test report:


- (a) date, time and place of sampling and sample identity number;
- (b) time and place of making specimens;
- (c) number and nominal size of specimens;
- (d) method of compaction (hand or vibration) including type of equipment used;
- (e) identification numbers of specimens;
- (f) name of supplier of specimens;
- (g) required age of the specimens at the time of testing;
- (h) conditions of curing and storage.

7.2.2 *Optional information.* If requested, the following information shall be provided by the producer of the test specimens for inclusion in the test report:


- (a) name of project and place where concrete used;
- (b) name of supplier and source of concrete;
- (c) date and time of production of concrete or delivery to site;
- (d) specification of concrete mix (e.g. strength grade);
- (e) consistence of the sample;
- (f) air content of the sample (if air-entrained).

7.3 Information to be provided by the test laboratory. The following information shall be provided by the test laboratory for inclusion in the test report:

- (a) identification of the specimen;
- (b) checked nominal or measured dimensions of the specimen;
- (c) date of receipt of the specimen at the laboratory;
- (d) condition of the specimen when received (include poor compaction, honeycombing or bad dimensions);
- (e) description of treatment to remove fins;
- (f) conditions of curing or storage at the laboratory;
- (g) moisture condition at testing (saturated or moist);
- (h) date of test;
- (i) age of the specimen at test;
- (j) mass of the specimen (as-received or saturated);
- (k) density of the specimen (as-received or saturated and the method of determining the volume);
- (l) maximum load at failure;
- (m) tensile splitting strength;
- (n) appearance of concrete and type of fracture if these are unusual;
- (o) certificate that the test has been carried out in accordance with this Part of this standard;
- (p) other remarks.


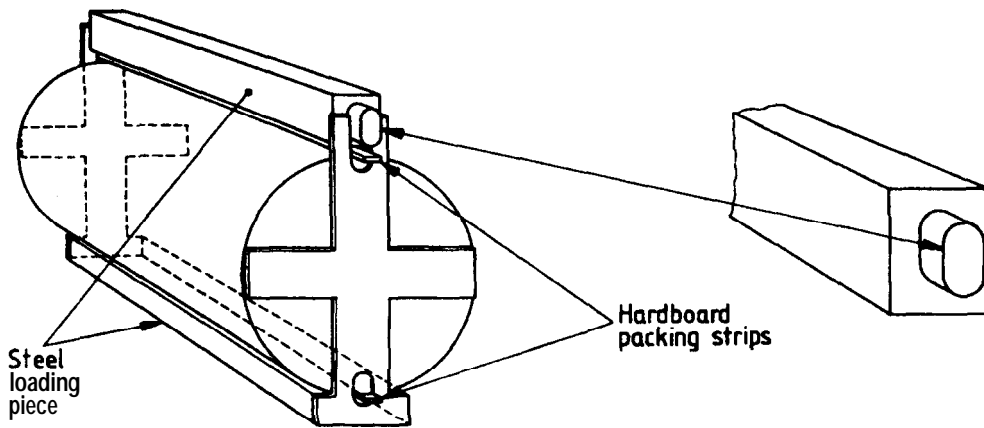


(e) Apparatus A for splitting cylinders

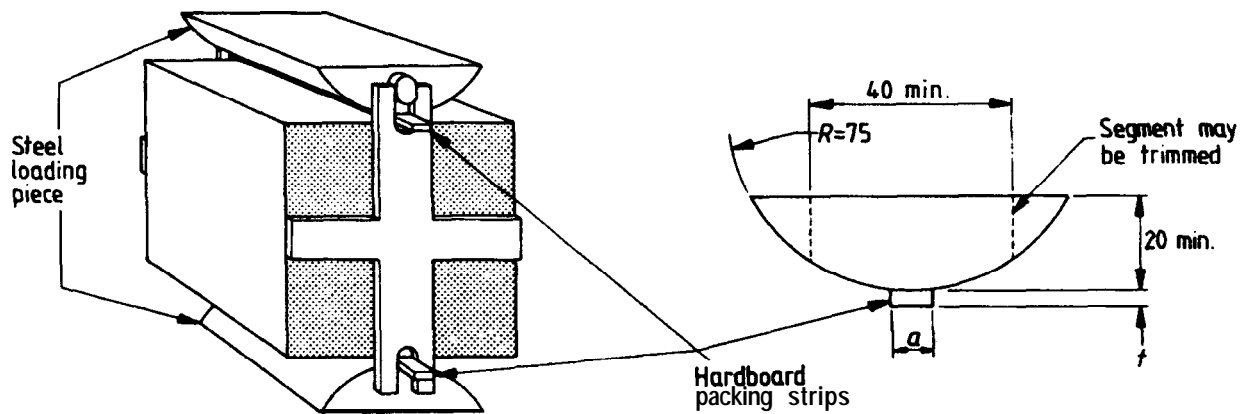

All dimensions are in millimetres.

(b) Apparatus A for splitting cubes and prismatic specimens

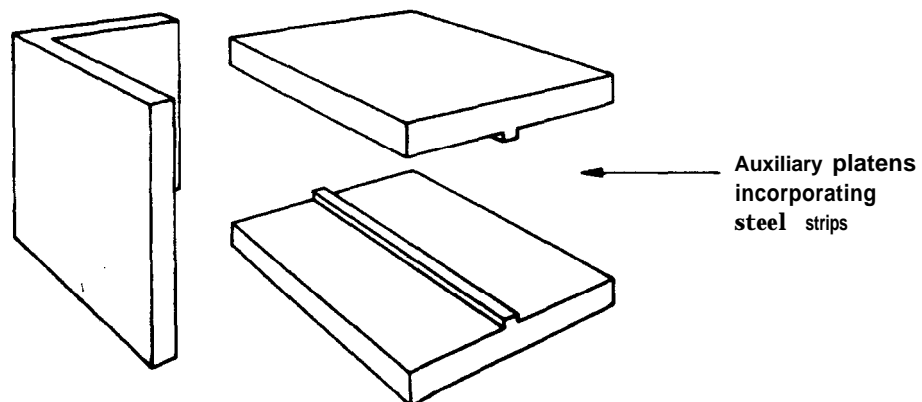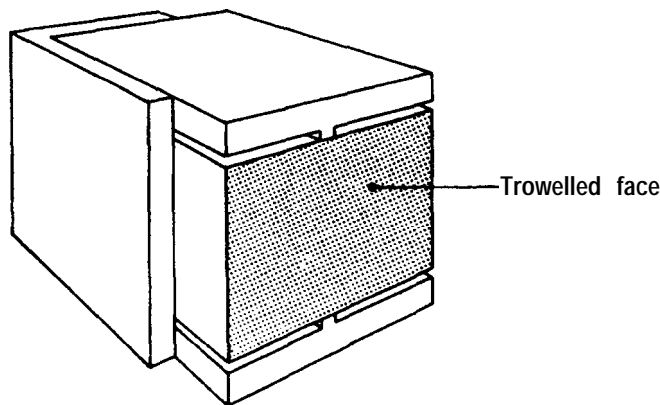

(c) Apparatus B for splitting cubes and prismatic specimens

Figure 1. Suitable jigs for the tensile splitting strength test



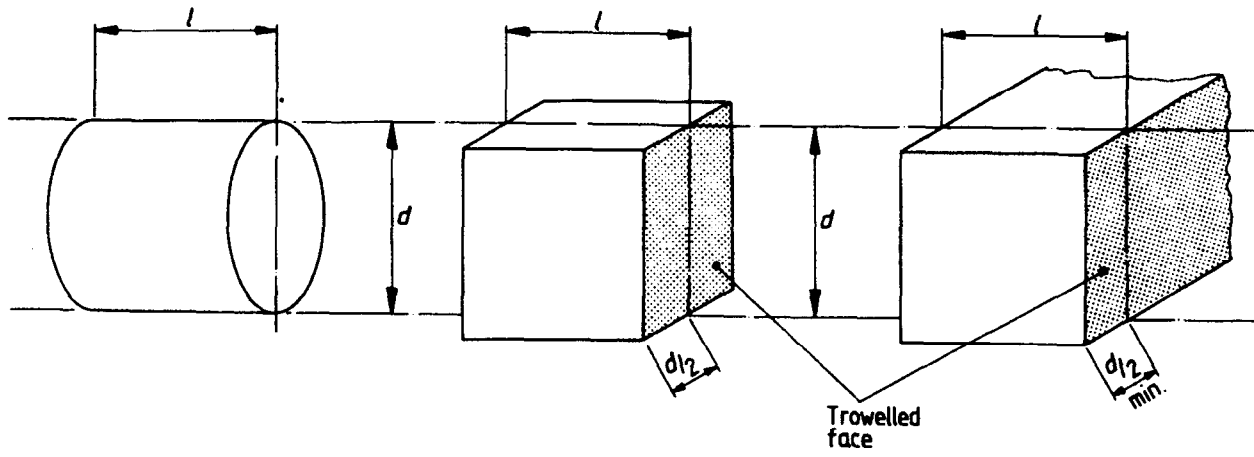


Figure 2 Plane of loading

Publications referred to

BS 1142	Fibre building boards
BS 1881	Methods of testing concrete
	Part 1 Methods of sampling fresh concrete
	Part 101 . Methods for sampling fresh concrete
	Part 114 Methods for determination of density of hardened concrete
	Part 115 Specification for compression testing machines for concrete
BS 5328	Methods for specifying concrete, including reedymixed concrete
BS 6497	Precision of test methods
	Part 1 Guide for the determination of repeatability and reproducibility for a standard test method
ISO 4108-1980†	Concrete – Determination of tensile splitting strength of test specimens

*In course of preparation.

†Referred to in the foreword only.



S

BS 1881 : Part 117 : 1983

This British Standard, having been prepared under the direction of the Cement, Gypsum, Aggregates and Quarry Products Standards Committee, was published under the authority of the Board of BSI and comes into effect on 31 January 1983.

@British Standards Institution, 1983

ISBN 0 580 12951 9

The following BSI references relate to the work on this standard:
Committee reference CAB/4 Draft for comment 80/12101 DC

British Standards Institution. Incorporated by Royal Charter, BSI is the independent national body for the preparation of British Standards. It is the UK member of the International Organization for Standardization and UK sponsor of the British National Committee of the International Electrotechnical Commission.

In addition to the preparation and promulgation of standards, BSI offers specialist services including the provision of information through the BSI Library and Standardline Database; Technical Help to Exporters; and other services. Advice can be obtained from the Enquiry Section, BSI, Milton Keynes MK14 6LE. telephone 0908 221166, telex 825777.

Copyright. Users of British Standards are reminded that copyright subsists in all BSI publications. No part of this publication may be reproduced in any form without the prior permission in writing of BSI. This does not preclude the free use, in the course of

implementing the standard, of necessary details such as symbols and size, type or grade designations. Enquiries should be addressed to the Publications Manager, BSI, Linford Wood, Milton Keynes MK14 6LE. The number for telephone enquiries is 0908 220022 and for telex 825777.

Contract requirements. A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Revision of British Standards. British Standards are revised, when necessary, by the issue either of amendments or of revised editions. It is important that users of British Standards should ascertain that they are in possession of the latest amendments or editions.

Automatic updating service. BSI provides an economic, individual and automatic standards updating service called PLUS. Details are available from BSI Enquiry Section at Milton Keynes, telephone 0908 221166, telex 825777.

Information on all BSI publications is in the BSI Catalogue, supplemented each month by BS/ News which is available to subscribing members of BSI and gives details of new publications, revisions, amendments and withdrawn standards. Any person who, when making use of a British Standard, encounters an inaccuracy or ambiguity, is requested to notify BSI without delay in order that the matter may be investigated and appropriate action taken.

Cooperating organizations

The Cement, Gypsum, Aggregates and Quarry Products Standards Committee, under whose direction this British Standard was prepared, consists of representatives from the following:

- Association of Consulting Engineers
- Association of County Councils
- Association of District Councils
- Association of Metropolitan Authorities
- Autoclaved Aerated Concrete Products Association
- *British Precast Concrete Federation Ltd.
- *British Quarrying and Slag Federation
- British Railways Board
- *British Ready Mixed Concrete Association
- British Steel Industry
- Cement Admixtures Association
- *Cement and Concrete Association
- *Cement Makers' Federation
- Chemical Industries Association
- *Concrete Society Limited
- *County Surveyors' Society
- 'Department of the Environment (Building Research Establishment)
- 'Department of the Environment (PSA)
- *Department of the Environment (Transport and Road Research Laboratory)
- 'Department of Transport
- *Federation of Civil Engineering Contractors
- Gypsum Products Development Association

- Institute of Quarrying
- *Institution of Civil Engineers
- *Institution of Highway Engineers
- *Institution of Municipal Engineers
- Institution of Public Health Engineers
- *Institution of Structural Engineers
- *Institution of Water Engineers and Scientists
- *National Federation of Building Trades Employers
- Natural Environment Research Council (Institute of Geological Science)
- *Royal Institute of British Architects
- *Royal Institution of Chartered Surveyors
- Sand and Ballast Hauliers and Allied Trades Alliance
- *Sand and Gravel Association Limited
- *Society of Chemical Industry
- Stone Federation

The organizations marked with an asterisk in the above list, together with the following, were directly represented on the Technical Committee entrusted with the preparation of this British Standard:

- British Civil Engineering Test Equipment Manufacturers' Association
- Electricity Supply Industry in England and Wales
- Greater London Council
- Institute of Concrete Technology
- Co-opted member

Amendments issued since publication

Amd. No.	Date of issue	Text affected

BS 1881 : Part 117 : 1983